

C:\TVCE PROJECTS\BRANNAN MOUNTAIN WATER TANK\DWG\T1.0 TITLE SHEET BMR WATER TANK.DWG


LEGEND		
PROPOSED		EXISTING
---OH---	CABLE TV OVERHEAD	---(TV)---
---OH---	POWER OVERHEAD	---E(OH)---
---OH---	TELEPHONE OVERHEAD	---T(OH)---
---T---	TELEPHONE UG	---T(UG)---
---E---	POWER (UNDERGROUND) UG	---E(UG)---
---G---	GAS LINE	---G---
←---○---	ANCHOR/GUY WIRE	←---○---
⊙	SEWER MANHOLE	⊙
---SS---	SEWER LINE	---SS---
--- ---○	FLUSHING BRANCH/CLEANOUT	--- ---○
--- ---	SEWER SERVICE	--- ---
⊙	STORM DRAIN MANHOLE	⊙
---SD---	STORM DRAIN PIPE	---SD---
■	STORM DRAIN INLET	■
---W---	WATER LINE	---W---
⊗	WATER VALVE	⊗
⊗	REDUCER	⊗
⊗	BLOW OFF ASSEMBLY	⊗
⊗	AIR RELIEF VALVE	⊗
⊗	FIRE HYDRANT ASSEMBLY	⊗
⊗	R.P. BACKFLOW PREVENTER	⊗
---	DRIVE WAY	---
---	SIDEWALK RAMP	---
---	BARRICADE	---
---	CENTERLINE	---
---	RIGHT OF WAY LINE	---
---	PROPERTY LINE	---
---	EASEMENT LINE	---
---	EDGE OF PAVEMENT	---
---	FENCE LINE	---
---	CONTOUR LINE	---
---	SIDEWALK	---
⊗	STREET LIGHT	⊗
⊗	STREET NAME SIGN	⊗
⊗	SIGN	⊗

BRANNAN MOUNTAIN WATER TANK


for:

WILLOW CREEK COMMUNITY SERVICES DISTRICT.

WILLOW CREEK, HUMBOLDT COUNTY, CALIFORNIA

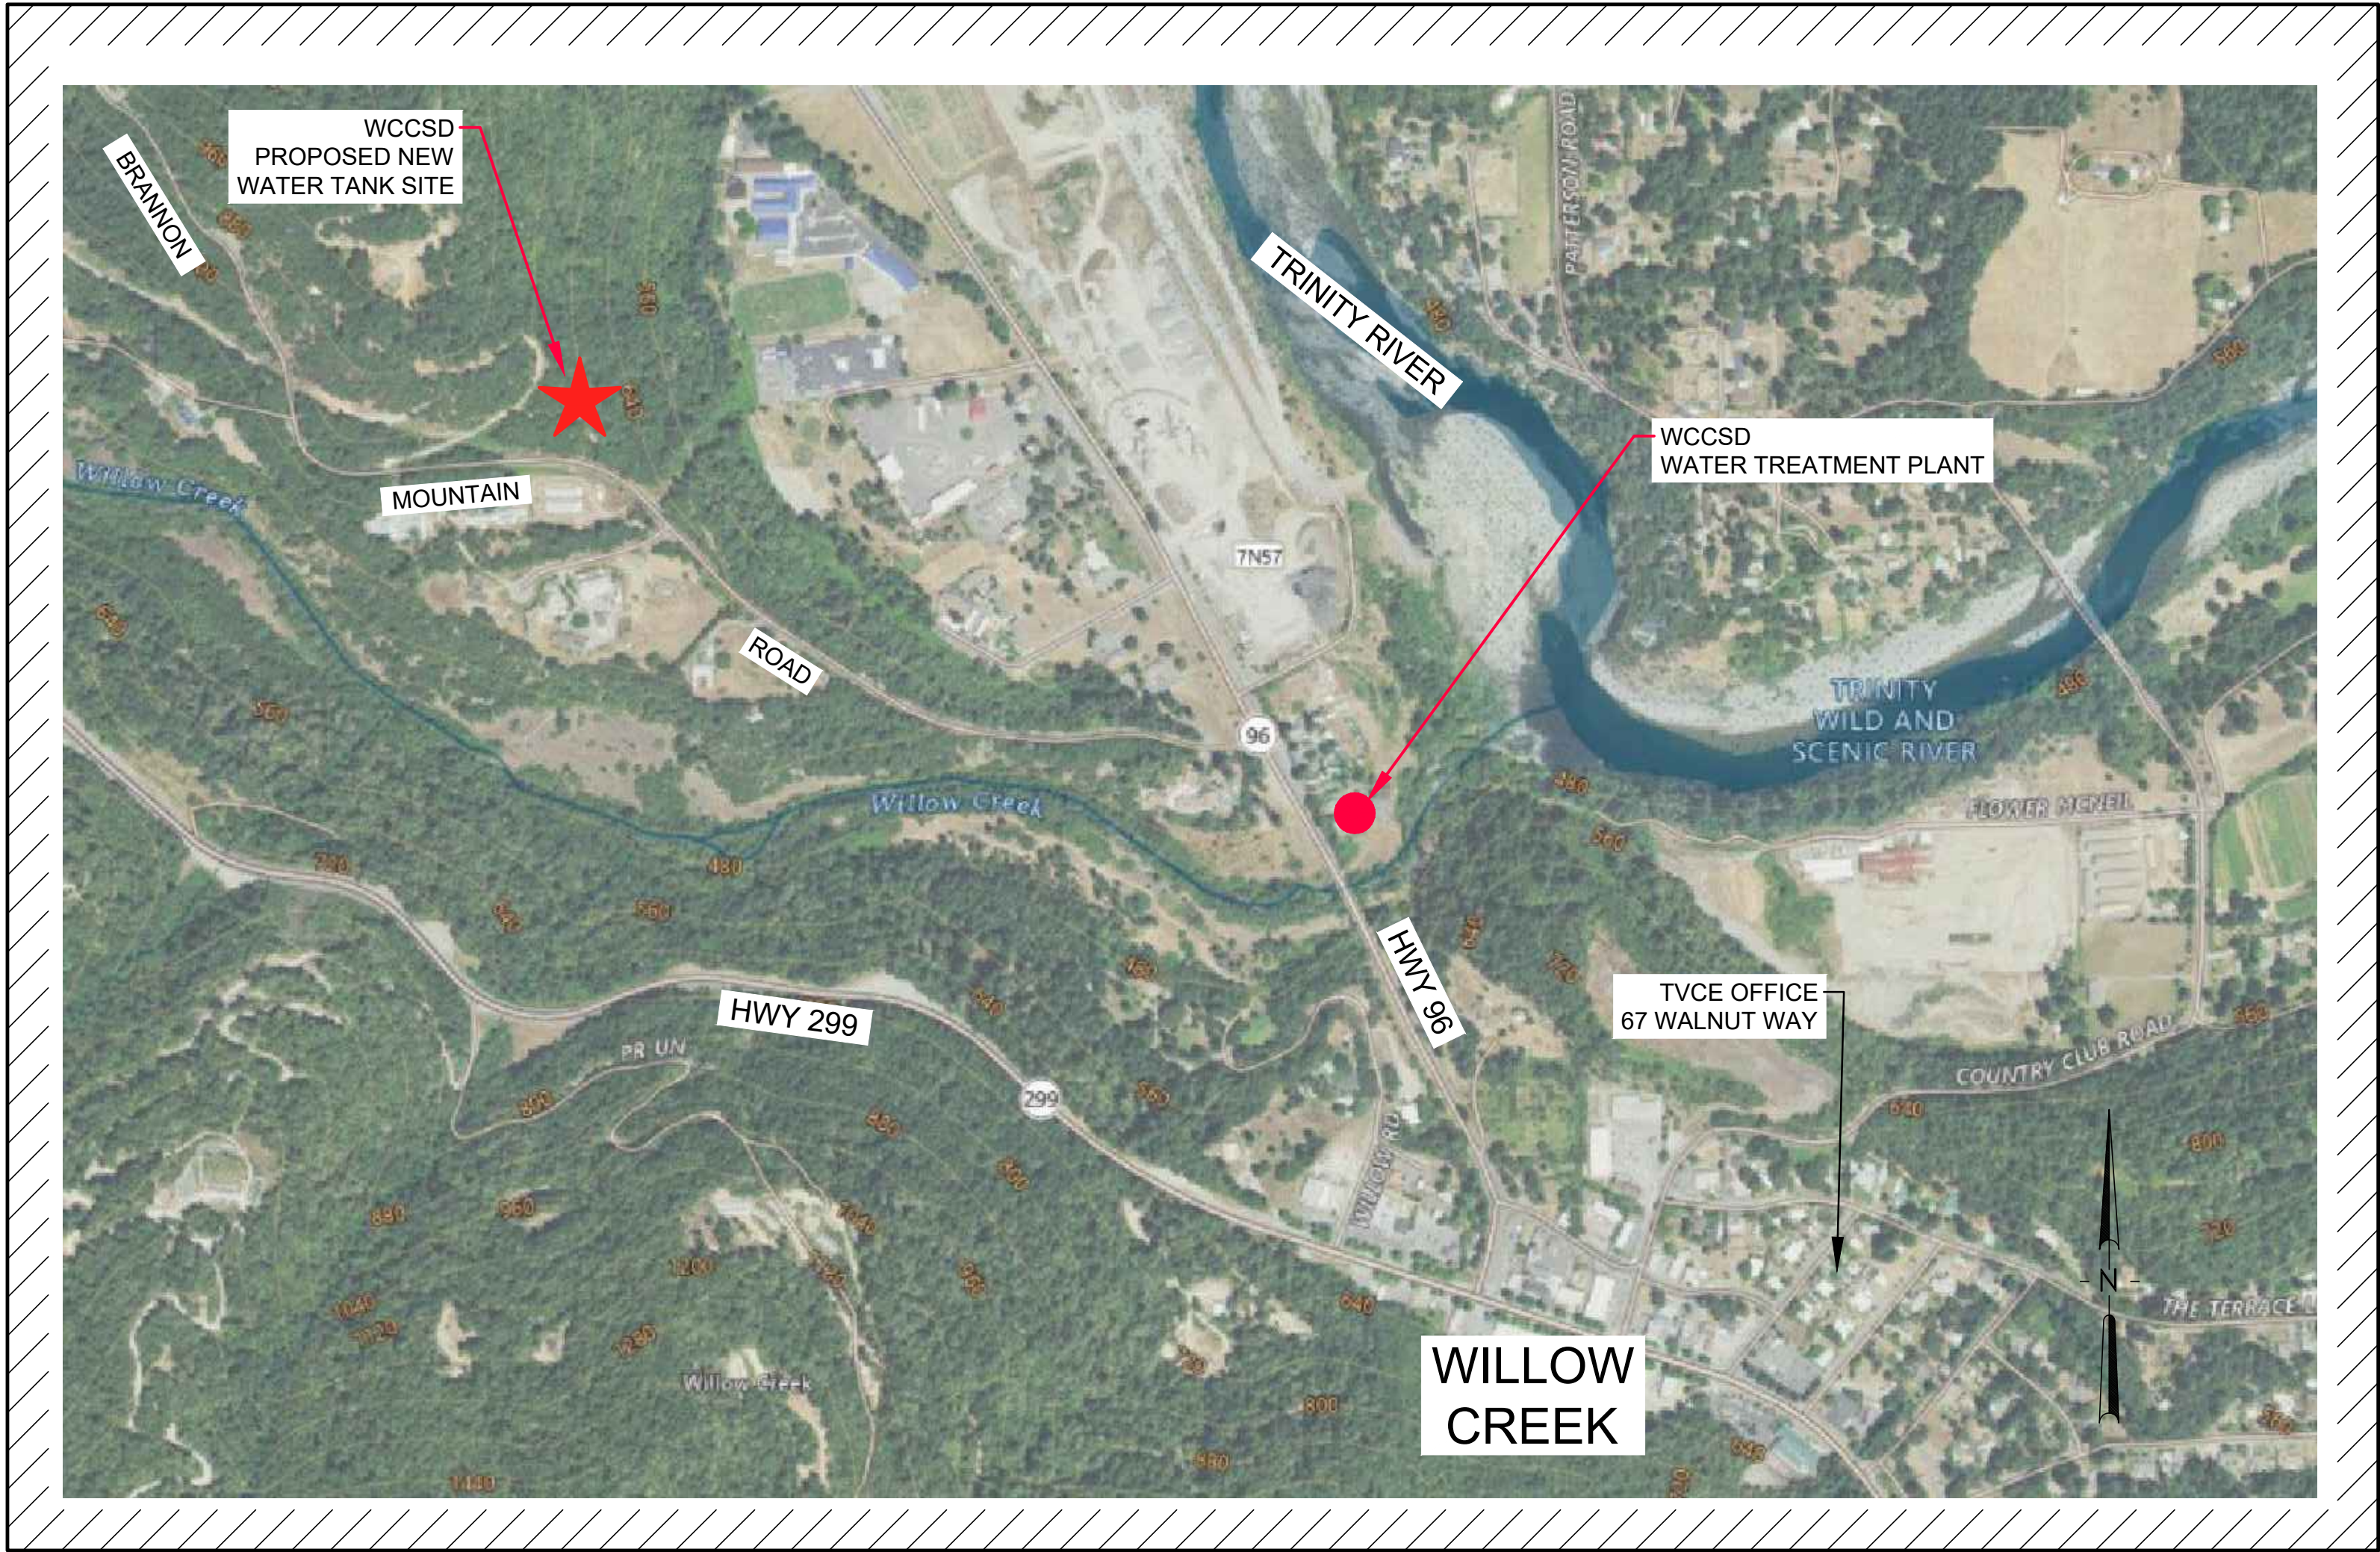

LOCATION MAP
NOT TO SCALE

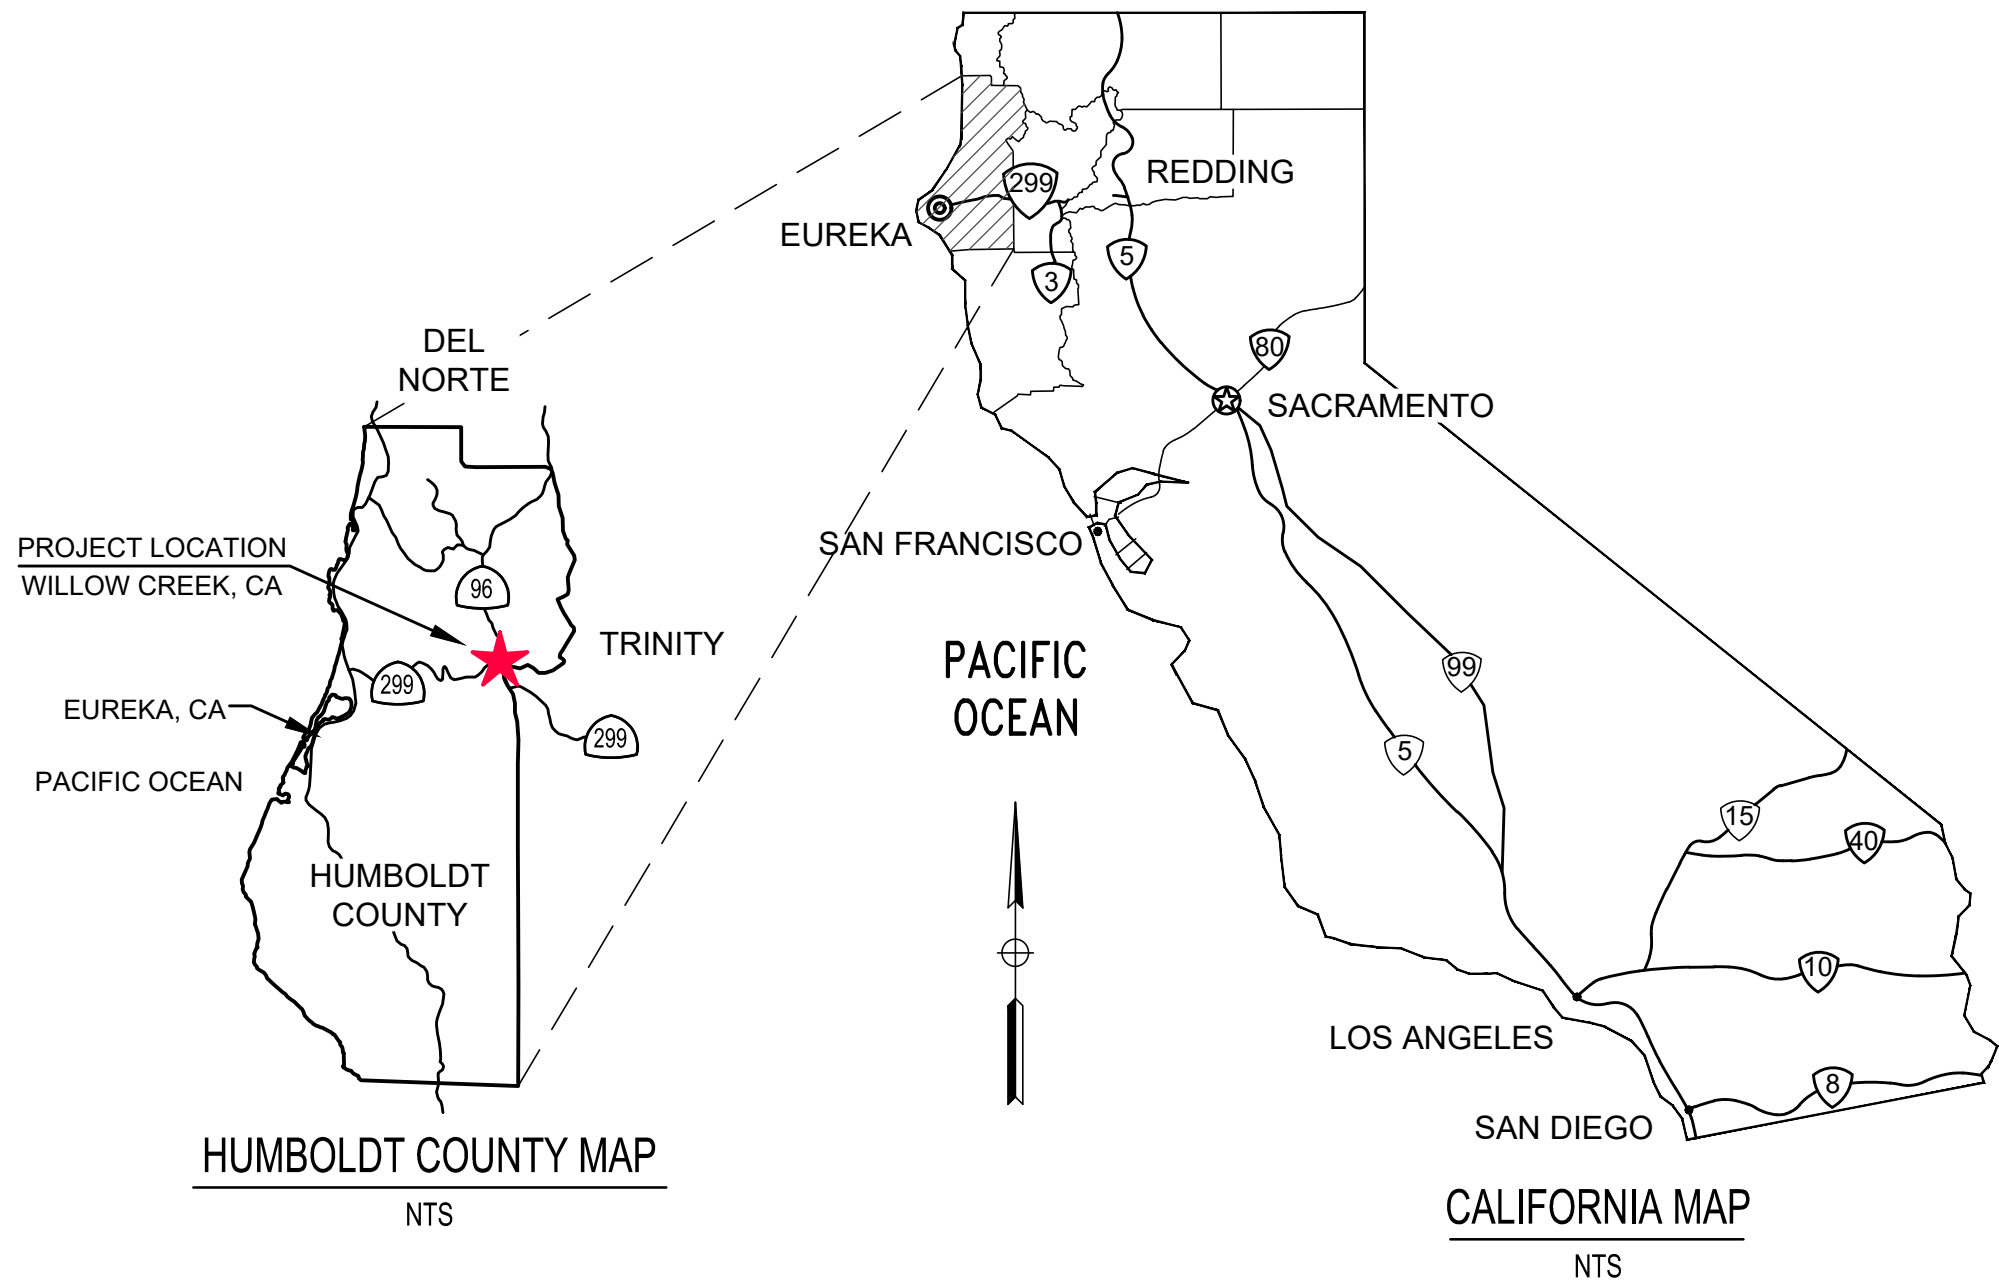

SURVEY NOTES
FIELD SURVEY FOR TOPOGRAPHIC PURPOSES WAS PERFORMED BY TVCE FEBRUARY, 2025

A BOUNDARY SURVEY WAS NOT CONDUCTED BY TVCE. A BOUNDARY MONUMENT WAS LOCATED AT SE PROPERTY CORNER. BOUNDARY SHOWN IS FROM COUNTY RECORD DATA.

ENGINEERING NOTES
ALL REQUIREMENTS FROM THE SOILS REPORT HAVE BEEN INCORPORATED INTO THESE PLANS.

THE ENGINEER OF RECORD SHALL INSPECT ALL SITE GRADING.

CONTRACTOR ALERT!

CONTRACTOR MUST CONTACT USA NORTH 811 AT LEAST 72 HOURS BEFORE ANY EARTHWORK OR ACTIVITIES THAT MAY IMPACT EXISTING UNDERGROUND UTILITIES.

EXISTING UTILITY ALIGNMENTS BOTH HORIZONTALLY AND VERTICALLY MUST BE VERIFIED BY THE CONTRACTOR PRIOR TO ANY CONSTRUCTION ACTIVITIES.

SHEET INDEX		
SHEET NO.	DWG NO.	DESCRIPTION
CIVIL		
1	T1.0	TITLE SHEET
2	C1.0	GENERAL NOTES
3	C2.0	NOTES & QUANTITIES
4	C3.0	EXISTING SITE OVERVIEW
5	C4.0	PROPOSED SITE GRADING PLAN
6	C5.0	SITE CROSS SECTIONS
7	C6.0	RETAINING WALL PLAN & PROFILE
8	C7.0	WATERLINE PLAN & PROFILE
9	C8.0	PROCESS DIAGRAM
10	C9.0	EROSION CONTROL PLAN
11	D1.0	TANK PIPING DETAILS
12	D2.0	TANK PIPING DETAILS
13	D3.0	TRENCH DETAILS
13	D4.0	FENCE DETAILS



PRELIMINARY

REVISIONS

DATE/DESCRIPTION

BRANNAN MOUNTAIN ROAD
WATER TANK
WILLOW CREEK COMMUNITY
SERVICES DISTRICT
135 WILLOW RD,
WILLOW CREEK, CA 95573

TITLE SHEET

DESIGN BY: EK
DRAWN BY: SG
CHECKED BY: EK
DATE: 4/7/25
SCALE: NO SCALE
PROJECT NO: 209.19

T1.0

C:\TYCE PROJECTS\BRANNAN MOUNTAIN WATER TANK\DWG\C1.0 NOTES.DWG

GENERAL NOTES:

1. DETAILS OF CONSTRUCTION, MATERIALS AND WORKMANSHIP NOT SHOWN IN THESE DRAWINGS SHALL CONFORM TO THE PERTINENT REQUIREMENTS OF THE STANDARD SPECIFICATIONS AND ANY APPLICABLE CONTRACT SPECIFICATIONS.
2. THE CONTRACTOR SHALL PROVIDE ALL UTILITIES AS NECESSARY TO SUCCESSFULLY COMPLETE ANY AND ALL CONSTRUCTION ACTIVITIES.
3. ALL EXISTING FENCES AND UTILITIES SHALL BE PROTECTED FROM DAMAGE DURING CONSTRUCTION OR BE REPLACED AT THE CONTRACTOR'S EXPENSE.
4. ALL EXISTING AND PROPOSED DIMENSIONS SHALL BE VERIFIED BY THE CONTRACTOR PRIOR TO STARTING WORK.
5. CONTRACTOR SHALL COORDINATE WITH PUBLIC WORKS DEPT. ON ALL CONSTRUCTION ACTIVITIES.
6. THE CONTRACTOR SHALL TAKE ALL PRECAUTIONARY MEASURES NECESSARY TO PROTECT EXISTING UTILITIES, WHICH ARE TO REMAIN IN PLACE, FROM DAMAGE. ANY DAMAGE DONE BY THE CONTRACTOR'S OPERATIONS SHALL BE EXPEDITIOUSLY REPAIRED OR RECONSTRUCTED TO THE ENGINEER'S SATISFACTION AT THE CONTRACTOR'S SOLE EXPENSE WITHOUT ADDITIONAL COMPENSATION.
7. THE TYPES, LOCATIONS, SIZES, AND DEPTHS OF EXISTING UNDERGROUND UTILITIES AS SHOWN ON THESE IMPROVEMENT PLANS WERE OBTAINED FROM SOURCES OF VARYING RELIABILITY. THE CONTRACTOR IS CAUTIONED THAT ONLY ACTUAL EXCAVATION WILL REVEAL THE TYPES, EXTENT, SIZES, LOCATIONS, AND DEPTHS OF SUCH UNDERGROUND UTILITIES. A REASONABLE EFFORT HAS BEEN MADE TO LOCATE AND DELINEATE ALL KNOWN UNDERGROUND UTILITIES, HOWEVER, THE ENGINEER CAN ASSUME NO RESPONSIBILITY FOR THE COMPLETENESS OR ACCURACY OF ITS DELINEATION OF SUCH UNDERGROUND UTILITIES NOR FOR THE EXISTENCE OF OTHER BURIED OBJECTS OR UTILITIES WHICH MAY BE ENCOUNTERED BUT WHICH ARE NOT SHOWN ON THESE DRAWINGS.
8. THE CONSTRUCTION CONTRACTOR AGREES THAT IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONSTRUCTION CONTRACTOR WILL BE REQUIRED TO ASSUME SOLE AND COMPLETE RESPONSIBILITY FOR THE JOB SITE CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THE PROJECT, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY, THAT THIS REQUIREMENT SHALL BE MADE TO APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS, AND THE CONSTRUCTION CONTRACTOR FURTHER AGREES TO DEFEND, INDEMNIFY AND HOLD THE DESIGN PROFESSIONAL HARMLESS FROM ANY AND ALL LIABILITY, REAL OR ALLEGED, IN CONNECTION WITH THE PERFORMANCE OF WORK ON THIS PROJECT, EXCEPTING LIABILITY ARISING FROM THE SOLE NEGLIGENCE OF THE DESIGN PROFESSIONAL.
9. TRAFFIC CONTROL FOR THIS PROJECT SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE FEDERAL HIGHWAY ADMINISTRATION STANDARD 635.
10. SAFE VEHICULAR AND PEDESTRIAN ACCESS SHALL BE PROVIDED AT ALL TIMES DURING CONSTRUCTION.
11. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING SURVEY MONUMENTS AND OTHER SURVEY MARKERS DURING CONSTRUCTION. ALL SUCH MONUMENTS OR MARKERS DESTROYED DURING CONSTRUCTION SHALL BE REPLACED AT THE CONTRACTOR'S EXPENSE.
12. THE CONTRACTOR SHALL OBTAIN ALL REQUIRED PERMITS FOR ENCROACHMENTS.
13. THESE PLANS ARE TO BE USED WITH THE LATEST EDITION OF CALTRANS STANDARD PLANS AND STANDARD SPECIFICATIONS; AND TRINITY COUNTY STANDARDS.
14. SAND SHALL NOT BE USED FOR PIPE BACKFILL OR BEDDING.
15. DROP INLET GRATES SHALL BE GALVANIZED AND BICYCLE PROOF.
16. CONCRETE DRIVEWAYS SHALL BE CONSTRUCTED PER TRINITY COUNTY STANDARDS.
17. PROPER HANDICAPPED ACCESS SHALL BE PROVIDED FOR ALL SIDEWALKS.
18. HANDICAP RAMPS SHALL BE CONSTRUCTED PER ADA STANDARDS.
19. UNDERGROUND NOTE:
DATA PERTAINING TO EXISTING UNDERGROUND FACILITIES AS INDICATED HEREIN IS FOR INFORMATION PURPOSES ONLY. CONTRACTOR SHALL BE RESPONSIBLE FOR CONTACTING ALL AGENCIES INVOLVED AND SHALL LOCATE ALL FACILITIES PRIOR TO EXCAVATION IN ANY AREA. VERIFY LOCATIONS AND DEPTHS OF EXISTING FACILITIES PRIOR TO CONSTRUCTION OF NEW FACILITIES. NOTIFY DESIGN ENGINEER OF ANY DISCREPANCIES.
20. LAYOUT WORK (CONSTRUCTION STAKING) SHALL BE PERFORMED BY A PERSON PROPERLY LICENSED TO PERFORM CONSTRUCTION STAKING IN THE STATE OF CALIFORNIA.
21. CONTRACTORS SHALL POSSESS THE PROPER CONTRACTOR'S LICENSE.
22. AN ENCROACHMENT PERMIT SHALL BE OBTAINED FROM APPLICABLE AGENCIES FOR ANY WORK WITHIN COUNTY OR STATE RIGHT OF WAY.
23. NO WATER JETTING PERMITTED.
24. MISCELLANEOUS IRON SHALL BE GALVANIZED (EXCEPT MANHOLE COVERS).

DUST CONTROL NOTES:

1. THE CONTRACTOR SHALL IMPLEMENT ONE OR BOTH OF THE FOLLOWING MEASURES FOR DUST CONTROL ON THIS SITE:
2. SPRAYING OF WATER SO AS NOT TO GENERATE ADDITIONAL RUNOFF. NO DUST PALLIATIVE MATERIALS OTHER THAN WATER WILL BE USED ON THIS PROJECT. IF NON-POTABLE WATER IS TO BE USED, IT MUST BE CONVEYED IN TANKS OR PIPES CLEARLY LABELED AS "NON-POTABLE WATER - DO NOT DRINK".
3. COVERS FOR EXPOSED AREAS.

EQUIPMENT & MATERIALS STORAGE NOTES:

1. IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENSURE THAT ALL MATERIALS AND EQUIPMENT STORED ONSITE SHALL HAVE ADEQUATE COVERINGS AND CONTAINMENT TO PREVENT LEAKAGE AND SPILLS.
2. ALL MATERIALS AND EQUIPMENT SHALL BE STORED IN DESIGNATED AND APPROVED AREAS. THE AREA SHALL BE BERMED WITH EARTH DIKES THAT THE CONTRACTOR SHALL INSPECT AND MAINTAIN WEEKLY.
3. ALL FLAMMABLE, REACTIVE, AND/OR IGNITABLE LIQUIDS MUST COMPLY WITH LOCAL FIRE CODES.
4. DURING THE RAINY SEASON (OCTOBER THROUGH APRIL) THE CONTRACTOR SHALL ENSURE THAT MATERIALS ARE COVERED.
5. NO CHEMICALS, DRUMS, OR BAGGED MATERIALS SHALL BE STORED DIRECTLY ON THE GROUND; ITEMS SHALL BE PLACED ON PALLETS AND/OR IN SECONDARY CONTAINMENT.
6. IF DRUMS MUST BE KEPT UNCOVERED, THE CONTRACTOR SHALL STORE THEM AT A SLIGHT ANGLE TO REDUCE PONDING OF RAINWATER AND REDUCE CORROSION.
7. WHEN DANGEROUS MATERIALS AND/OR LIQUID CHEMICALS ARE UNLOADED ONSITE, THE CONTRACTOR SHALL HAVE EMPLOYEES TRAINED IN EMERGENCY SPILL CLEANUP PROCEDURES PRESENT.

VEHICLE MAINTENANCE NOTES:

1. EQUIPMENT AND VEHICLES TRAVELING ONSITE SHALL BE INSPECTED REGULARLY FOR LEAKS AND BE REPAIRED IMMEDIATELY; DO NOT ALLOW LEAKING VEHICLES ONSITE. KEEP VEHICLES AND EQUIPMENT CLEAN (DO NOT ALLOW EXCESSIVE BUILDUP OF OIL AND GREASE).
2. USE OFFSITE REPAIR SHOPS WHENEVER POSSIBLE; IF ONSITE REPAIRS ARE NECESSARY, USE A DESIGNATED AREA SURROUNDED BY EARTH BERMS. THE CONTRACTOR SHALL INSPECT THIS AREA WEEKLY AND AFTER EACH RAINSTORM EVENT TO ENSURE THAT THE EARTH BERMS ARE IN PLACE AND FUNCTIONING PROPERLY; ANY NON-FUNCTIONING BERMS SHALL BE REPAIRED IMMEDIATELY.
3. USE DRY CLEAN-UP METHODS FOR SPILLS AS MUCH AS POSSIBLE; USE ABSORBENT MATERIALS FOR SMALL SPILLS AND DISPOSE OF PROPERLY. USE A SECONDARY CONTAINMENT DURING FLUID CHANGES AND REPAIRS TO CATCH SPILLS.
4. SEGREGATE AND RECYCLE WASTES (INCLUDING BUT NOT LIMITED TO: USED OIL AND OIL FILTERS, BATTERIES, ETC.). KEEP HAZARDOUS WASTES SEPARATE FROM NON-HAZARDOUS WASTES; AFTER REPAIRS, ETC., PROMPTLY TRANSFER USED FLUIDS AND WASTES TO THEIR PROPER CONTAINMENT AREAS AND CONTAINERS.

CULTURALLY SENSITIVE AREAS:

1. AREAS WITHIN THE PROJECT PERIMETER THAT ARE CULTURALLY SENSITIVE SHALL BE PROTECTED AGAINST DAMAGE FROM CONSTRUCTION ACTIVITIES. AT NO TIME SHALL SUCH CULTURALLY SENSITIVE AREAS BE ENTERED, PARKED UPON, STOCK PILED UPON, OR HAVE ANY OTHER ACTIVITY ASSOCIATED WITH THE CONSTRUCTION OF THIS PROJECT IN ANY WAY INFRINGE UPON, DETERIORATE, DESTROY, OR RENDER TO A STATE OR CONDITION UNACCEPTABLE ANY CULTURALLY SENSITIVE AREA. THE CONTRACTOR AGREES TO PROTECT ALL SUCH AREAS DURING ANY AND ALL ACTIVITIES ASSOCIATED WITH THE CONSTRUCTION OF THIS PROJECT.

QUANTITIES:

1. QUANTITIES AND LENGTHS OF ITEMS PROVIDED WITHIN THIS PLAN SET ARE APPROXIMATE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY ACTUAL QUANTITIES OF COMPONENTS REQUIRED FOR THE SUCCESSFUL AND SATISFACTORY COMPLETION OF THE PROJECT.

AGGREGATE BASE ROCK NOTES:

1. AGGREGATE BASE SHALL BE CALTRANS CLASS II.
2. AGGREGATE BASE SHALL BE INSTALLED PER SECTION 26 OF THE CALTRANS STANDARD SPECIFICATIONS.
3. AGGREGATE BASE SHALL BE COMPACTED TO A MINIMUM OF 95% RELATIVE COMPACTION PER CAL 316.

ASPHALT CONCRETE NOTES:

1. ASPHALT CONCRETE SHALL BE $\frac{1}{2}$ " MAXIMUM RADIUS HOT MIX TYPE A.
2. ASPHALT CONCRETE SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SECTION 39 OF THE CALTRANS STANDARD SPECIFICATIONS.
3. ASPHALT CONCRETE SHALL BE COMPACTED TO A MINIMUM OF 95% RELATIVE COMPACTION AS VERIFIED PER CAL 216.
4. EXISTING AC SURFACES SHALL BE CUT TO A NEAT STRAIGHT LINE PARALLEL WITH THE CENTERLINE AND THE EXPOSED EDGE SHALL BE TACKED WITH EMULSION PRIOR TO PAVING. THE EXPOSED BASE MATERIAL SHALL BE GRADED, RE-COMPACTED, AND RESEALED PRIOR TO PAVING.

ELECTRIC GENERAL NOTES:

1. ALL ELECTRIC FACILITIES AND WORK TO BE IN STRICT COMPLIANCE WITH APPLICABLE LAWS AND MUST MEET PACIFIC GAS AND ELECTRIC (PG&E) REQUIREMENTS PER CURRENT GREEN BOOK.
2. REFER TO PG&E SITE PLAN FOR ADDITIONAL DETAILS NOT EXPRESSED ON THIS SHEET.
3. CONTRACTOR TO COORDINATE WITH PG&E FOR ALL REQUIRED TESTING/INSPECTION AND FOR PG&E INSTALLED FACILITIES.
4. OWNER HAS THE RESPONSIBILITY OF PAYING ALL FEES TO PG&E DIRECT FOR THEIR SERVICES/FACILITIES UNDER THE ORIGINAL APPLICATION FOR THIS PROJECT. ADDITIONAL COSTS RESULTING DIRECTLY FROM THE CONTRACTOR'S ACTIVITIES AND NOT EXPRESSLY COVERED UNDER THE ORIGINAL APPLICATION WILL BE THE SOLE EXPENSE OF THE CONTRACTOR.
5. POWER/ELECTRICAL FACILITIES DEPICTED ON THESE PLAN SETS ARE FOR GENERAL LOCATION PURPOSES, ACTUAL HARDWARE, ALIGNMENTS, PLACEMENT, AND DESIGN TO BE PROVIDED BY PACIFIC GAS & ELECTRIC (PG&E). CONTRACTOR TO COORDINATE WITH PG&E FOR DESIGN AND INSTALLATION OF REQUIRED COMMUNICATION FACILITIES.

CULVERT NOTES:

1. CULVERT TYPE: CULVERTS SHOULD BE RIDGED CORRUGATED METAL PIPE (CMP) OR RIGID CORRUGATED PLASTIC PIPE (CPP) WITH A SMOOTH INTERIOR MAY BE USED IF APPROVED PRIOR TO INSTALLATION.
2. CULVERT SIZE: CULVERT DIAMETER SHOULD BE DETERMINED BY A HYDRAULIC REPORT. PER TRINITY COUNTY ROAD STANDARDS, THE CULVERT SHALL BE A MINIMUM OF EIGHTEEN (18") INCH DIAMETER. THE LENGTH OF THE PIPE SHOULD BE A MINIMUM OF 20' AND CAN BE EXTENDED WITH ADDITIONAL LENGTHS AS NEEDED TO EFFECTIVELY CONVEY WATER UNDER THE ROAD PRISM.
3. GRADE: INSTALL THE CULVERT TO MATCH THE GRADE TO THE FLOW LINE OF THE ABUTTING DITCHES OR STREAM. SETTING THE CULVERT AT THE WRONG GRADE, OR WITH ONE END TOO HIGH OR TOO LOW, CAN CAUSE FLOODING, SCOURING AND EROSION.
4. ALIGNMENT: PLACE THE CULVERT IN THE SAME ALIGNMENT AS THE STREAM EVEN IF THIS MEANS THE CULVERT IS NOT PERPENDICULAR TO THE ROADBED.
5. END TREATMENT: THE INLET OF THE PIPE SHOULD BE PLACED AT OR BELOW THE DITCH FLOW LINE (NOT ABOVE) WITH ROCK ARMORING OR END SECTION AS SHOWN ON THE PLAN OR AS DIRECTED. THE OUTLET SHOULD BE EXTENDED BEYOND THE ROAD FILL PRISM. IF THIS IS NOT POSSIBLE THEN A CULVERT DOWN-SECTION SHOULD BE INSTALLED AND SECURED TO THE SLOPE TO EXTEND THE CULVERT TO BEYOND THE ROAD RILL PRISM. THE OUTLET SHOULD BE INSTALLED WITH ROCK ARMORING AS MEANS OF ENERGY DISSIPATION.
6. TRENCHING: TRENCHING SHOULD BE DONE AS NEAT AS POSSIBLE TO CREATE A CONSISTENTLY SMOOTH AND EVEN SURFACE TO INSTALL THE CULVERT. THE TRENCH SHOULD BE SUFFICIENTLY DEEP TO ALLOW FOR EIGHTEEN (18") INCHES OF COVER OVER THE TOP OF THE CULVERT.
7. BEDDING: COMPACT THE SUBGRADE PRIOR TO INSTALLING THE CULVERT.
8. COMPACTION: THE CAPACITY OF A CULVERT TO CARRY LOADS DEPENDS ON PROPER BACKFILLING, ESPECIALLY IN THE AREA UNDER THE HAUNCHES (LOWER THIRD). THE SOIL SURROUNDING THE CULVERT PROVIDES CRITICAL SUPPORT AND STRUCTURE. FOR MAXIMUM STRENGTH, AND TO PREVENT WASH OUTS AND SETTLING, THE BACKFILL MUST BE PROPERLY PLACED AND CAREFULLY COMPACTED. DRY TRENCH CONDITIONS MAKE THE PROCESS MORE EFFICIENT. WHEN BACKFILLING USE NO MORE THAN 6" LIFTS. BACKFILL MATERIAL SHOULD BE FREE OF ROCKS LARGER THAN 3" IN DIAMETER. THE MATERIAL MUST BE DUMPED CAREFULLY AND EVENLY ALONG BOTH SIDES OF THE PIPE. AVOID DUMPING LARGE QUANTITIES AT ONCE AGAINST OR ON TOP OF THE PIPE. INSTALLING TAMPED FILL BENEATH THE HAUNCHES OF ANY SHAPE OR TYPE OF PIPE HELPS IT WITHSTAND THE SOIL AND TRAFFIC LOADS.

GRADING NOTES:


1. ALL EARTHWORK, INCLUDING BUT NOT LIMITED TO, SITE CLEARING, GRUBBING, STRIPPING, AND GRADING WILL BE CONDUCTED DURING DRY WEATHER CONDITIONS. (TYPICALLY APRIL 15 TO OCTOBER 15)
2. ANY UNDOCUMENTED FILL SOILS, FINE-GRAINED RESIDUAL SOILS, AND ANY OTHER DEBRIS ENCOUNTERED AT OR BELOW THE EXISTING GROUND SURFACE SHALL BE REMOVED AT THE LOCATIONS RECEIVING ANY POTENTIAL FILLS.
3. THE SITE SHOULD BE GRADED TO PROVIDE ADEQUATE DRAINAGE SUCH THAT NO WATER IS ALLOWED TO POND ANYWHERE ON THE SITE OR MIGRATE BENEATH FUTURE DEVELOPMENTS.
4. ALL FILL MATERIAL SHALL BE PLACED IN HORIZONTAL LIFTS NOT TO EXCEED EIGHT INCHES (8") IN DEPTH AND SHALL BE COMPACTED MECHANICALLY.
5. ALL FILL MATERIAL SHALL BE FREE OF ORGANICS, ROCKS LARGER THAN 3"Ø, WOODY DEBRIS, ROOTS, AND INORGANIC MATERIAL.
6. ALL FILL MATERIAL SHALL HAVE A UNIFORM MOISTURE CONTENT AT OR NEAR OPTIMUM MOISTURE CONTENT AS DETERMINED BY TESTING AND APPROVED BY THE ENGINEER.
7. NON-STRUCTURAL FILL SHALL BE COMPACTED MECHANICALLY TO A FIRM UNYIELDING SURFACE AS APPROVED BY THE ENGINEER.
8. COMPACTION TESTING WILL BE DETERMINED AT THE ENGINEER'S DISCRETION.
9. IT IS RECOMMENDED THAT ANY MATERIAL PROPOSED FOR STRUCTURAL FILL MATERIAL TO SUPPORT ANY FOUNDATIONS OR STRUCTURAL BUILDING ELEMENT AND ASSOCIATED UTILITIES BE COMPACTED AS OUTLINED IN THE SOILS REPORT.
10. ALL FILL SLOPES SHALL BE TO A SMOOTH AND EVEN GRADE; SHALL BE SURFACE TRACKWALKED, AND FINAL GRADES NOT TO EXCEED 1.5:1 (h:v).
11. SUFFICIENT TESTING AND INSPECTION SHOULD BE PERFORMED TO MONITOR THE SUITABILITY OF FILL MATERIALS AND ASSURE COMPLIANCE WITH THE RECOMMENDED COMPACTION STANDARDS.

CLEARING, GRUBBING, & DEMOLITION NOTES:

1. TREES SCHEDULED TO BE REMOVED SHALL BE REMOVED COMPLETELY INCLUDING STUMPS, ROOTS, BRANCHES, WOODY DEBRIS, BARK, AND FLESH. TREES SHALL BE REMOVED FROM THE SITE AND DEPOSITED IN LOCATIONS DESIGNATED BY THE OWNER.
2. VEGETATION AND WOODY DEBRIS SHALL BE REMOVED FROM THE SITE AND DISPOSED OF IN A MANNER CONSISTENT WITH APPLICABLE LAWS AND REGULATIONS.
3. ALL GENERATED AND ACCUMULATED CONSTRUCTION DEBRIS SHALL BE REMOVED FROM THE SITE AND DISPOSED OF IN A MANNER CONSISTENT WITH APPLICABLE LAWS AND REGULATIONS.
4. ALL AREAS WITH GENERATED VOIDS FROM DEMOLITION ACTIVITIES SHALL BE BACKFILLED WITH NATIVE SOIL TO FINISH GRADE IN 1' MAXIMUM VERTICAL LIFTS SUFFICIENTLY COMPACTED TO ELIMINATE SUBSIDENCE.
5. DUST CONTROL SHALL BE MAINTAINED DURING DEMOLITION PRACTICES.
6. TRACKING OF MATERIAL FROM THE SITE ONTO EXISTING ROADWAYS WILL NOT BE TOLERATED. TEMPORARY CONSTRUCTION SITE ENTRANCES SHOULD BE BUILT AT POINTS OF INTERSECTION TO EXISTING ROADWAYS AND PRACTICES SHOULD BE IMPLEMENTED TO REMOVE CONSTRUCTION MATTER FROM VEHICLES AND EQUIPMENT PRIOR TO LEAVING THE CONSTRUCTION SITE.
7. EROSION CONTROL MEASURES SHALL BE IMPLEMENTED FOR THE SITE AS SOON AS PRACTICAL AND SHALL BE IN PLACE PRIOR TO EXECUTION OF MAJOR DEMOLITION OPERATIONS.

PERMIT NOTES:

1. THE APPLICANT SHALL CONTACT THE RESPECTIVE AGENCIES FOR SPECIFIC PERMIT REQUIREMENTS OR MITIGATION MEASURES SUCH AS REGIONAL WATER QUALITY CONTROL BOARD (RWQCB) 401 CERTIFICATION, U.S. ARMY CORPS OF ENGINEERS 404 PERMIT AND APPROVAL BY CALIFORNIA DEPARTMENT OF FISH AND WILDLIFE SERVICE 1600 PERMIT.
2. SPECIFIC REQUIREMENTS COULD INCLUDE IN-WATER WORK WINDOWS, VEGETATION SPECIES, SEED MIXES, STABILIZATION MEASURES, WATER QUALITY MONITORING PROTOCOLS, AND SPECIFIC REPORTING REQUIREMENTS.
3. IF NUMERICAL-BASED WATER QUALITY STANDARDS ARE MENTIONED IN ANY OF THESE OR OTHER RELATED PERMITS, TESTING ANY SAMPLING MAY BE REQUIRED.
4. PROPER PLANNING, DESIGN, AND CONSTRUCTION TECHNIQUES CAN MINIMIZE IMPACTS NORMALLY ASSOCIATED WITH IN-STREAM CONSTRUCTION ACTIVITIES. POOR PLANNING CAN ADVERSELY AFFECT SOIL, FISH, AND WILDLIFE RESOURCES, LAND USES, OR LAND USERS.

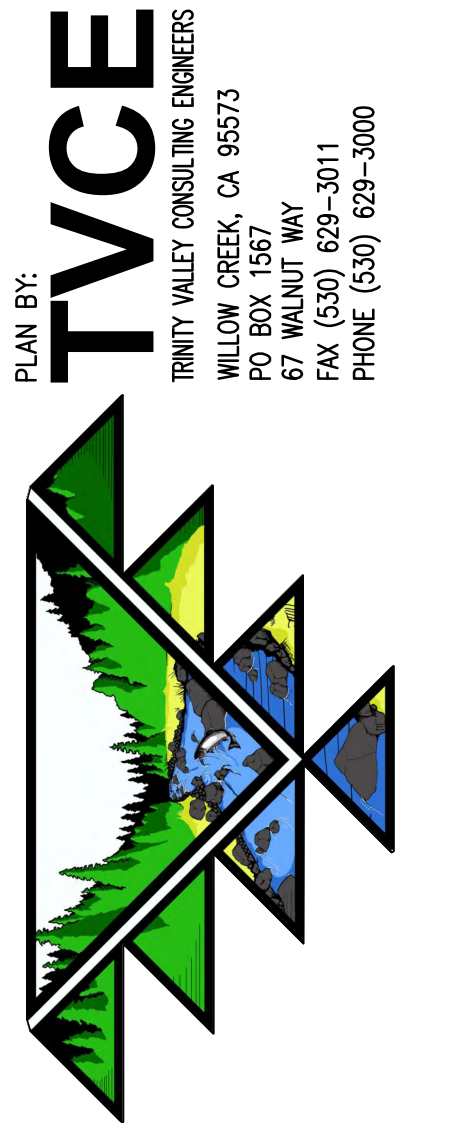

PRELIMINARY

NO.	DATE:	REVISIONS					

BRANNAN MOUNTAIN ROAD
WATER TANK
WILLOW CREEK COMMUNITY
SERVICES DISTRICT
135 WILLOW RD,
WILLOW CREEK, CA 95573

GENERAL NOTES

DESIGN BY: EK
DRAWN BY: SG
CHECKED BY: EK
DATE: 4/5/25
SCALE: NO SCALE
PROJECT NO: 209.19

C1.0

ABBREVIATIONS					
AC	ASPHALT CONCRETE	FM	FLOW METER	R	RADIUS, RANGE
ACP	ASBESTOS CEMENT PIPE	FNC	FENCE	RD	ROAD
AD	AREA DRAIN, ALGEBRAIC DIFFERENCE IN GRADE	FP	FLAG POLE	RB	REBAR
AG	ABOVE GROUND	FW	FINISH WATER	RCE	REGISTERED CIVIL ENGINEER
AGG.	AGGREGATE	G	GAS SERVICE	RCP	REINFORCED CONCRETE PIPE
APPROX.	APPROXIMATE	GB	POSTAL GANG BOX	RCR	RED CAP ROAD
ARV	AIR RELIEF VALVE	GD	GRADE	RCW	RECYCLE WATER
ASBA	AIR RELIEF VALVE	GND	GROUND	RJ	RESTRAINED JOINT
B	BELL FITTING	GRT	GATE	RSE	REINFORCED SOIL EMBANKMENT
BIT	BITUMINOUS	GV	GATE VALVE	RSL	ROCK SLOPE PROTECTION
BK	BACK	H	HORIZONTAL	R/W	RIGHT-OF-WAY
BLD'G	BUILDING	HD	HEAD	RD	ROAD
BOW	BOTTOM OF WALL	HDPE	HIGH DENSITY POLYETHYLENE PIPE	RT	ROUTE, RIGHT
BTWN	BETWEEN	HORIZ	HORIZONTAL	RTW	RINSE TO WASTE WATER
BVCE	BEGIN VERTICAL CURVE ELEVATION	HS	HIGH STRENGTH	RW	RAW WATER
BVCS	BEGIN VERTICAL CURVE STATION	HMAC	HOT MIX ASPHALT CONCRETE	S	SLOPE, SOUTH
BW	BACKWASH	HWY	HIGHWAY	SB	SET BACK
BN	BALL VALVE	IN	INLET	SD	STORM DRAIN
C	CIVIL	INT-X	INTERSECTION	SEC	SECTION
CAV	COMBINATION AIR VALVE	INV.	INVERT	S.F.	SQUARE FEET
CT	CALTRANS	IRR.	IRRIGATION WATER LINE	SG	SUBGRADE
CB	CATCH BASIN	JB	ELECTRICAL JUNCTION BOX	SHT	SHEET
C.I.P.	CAST IN PLACE	K	VERTICAL CURVE COEFFICIENT	SHLDR	SHOULDER
CL	CLASS	L	LENGTH	SIM	SIMILAR
CL	CENTERLINE	L.F.	LINEAL FEET	SL	STREET LIGHT
CLC	CONCRETE	LS	LICENSED SURVEYOR, LUMP SUM	SQ	SQUARE
CO	SEWER CLEANOUT	LT	LEFT	SR	STATE ROUTE
COR	CONTRACTING OFFICERS' REPRESENTATIVE	M	MEASURE (MEASURE LINE)	STA	STATION
CMP	CORRUGATED METAL PIPE	MAX.	MAXIMUM	STD	STANDARD
CP	CONTROL POINT	MIN.	MINIMUM	S.T.	SEPTIC TANK
CY	CUBIC YARD	MJ	MECHANICAL JOINT	SW	SURFACE WASH
D	DELTA	MOD	MODULAR, MODIFY	T, TEL	TELEPHONE
DIA	DIAMETER	MP	MILE MARKER POST	TBO	TO BE DETERMINED
DIP	DUCTILE IRON, DUCTILE IRON PIPE	MSE	MECHANICALLY STABILIZED EARTH	TC	TOP OF CONCRETE, TOP OF CURB
D/W, DWY	DRIVEWAY	MTN	MOUNTAIN	TD	TRENCH DRAIN
DET	DETAIL	NGS	NATIONAL GEODETIC SURVEY	THD	THREAD, THREADED
DH	DEPARTMENT OF HEALTH	(N)	NEW	TOW	TOP OF WALL
DI	DRAINAGE INLET	N	NORTHING, NORTH	TP	TOP OF HMAC
DIA	DIAMETER	NO	NUMBER	TYP	TYPICAL
DIM, DIMS	DIMENSIONS	NTS	NOT TO SCALE	TVCE	TRINITY VALLEY CONSULTING ENGINEERS
DP	DEEP	OC	ON CENTER	TW	TOP OF CONC. WALK
(E), EXIST	EXISTING	OHU	OVERHEAD UTILITY LINES	UG	UNDERGROUND
E	EASTING, EAST, ELECTRIC	P	ELECTRICAL PANEL	UGV	UNDERGROUND VOLTAGE LINE
EA	EACH	(P)	PROPOSED	UP	UTILITY POLE
EBV	ENDLINE BALLVALVE	PC	POINT OF CURVATURE	VAR	VARIABLE
EG	EXISTING GROUND, EXISTING GRADE	PC	POST CHLORINATION	VC	VERTICAL CURVE
EL, ELEV	ELEVATION	PCC	PORTLAND CEMENT CONCRETE	VERT	VERTICAL
EP	EDGE OF PAVEMENT	PERF	PERFORATED	VOLTAGE	VOLTAGE
EVCE	END VERTICAL CURVE ELEVATION	PI	POINT OF INTERSECTION	W	WEST, WATER, WIDTH
EVCS	END VERTICAL CURVE STATION	PL	PROPERTY LINE	W/O	WITHOUT
EXC	EXCAVATION	POB	POINT OF BEGINNING	W/	WITH
ET	ELECTRICAL TRANSFORMER	POLY	POLYMER	WM	WATER METER
F/C	FACE OF CURB	PP	POWER POLE/UTILITY POLE	WP	WEATHER PROOF
FG	FINISH GRADE	PRC	POINT OF REVERSE CURVE		
FH	FIRE HYDRANT	PRV	PRESSURE RELIEF VALVE	WTP	WATER TREATMENT PLANT
FHWA	FEDERAL HIGHWAY ADMINISTRATION	PT	POINT OF TANGENCY	WTR	WATER
FIN	FINISH	PVC	POINT OF VERTICAL CURVE	WV	WATER VALVE
FL	FLOW LINE, FOGLINE	PVI	POINT OF VERTICAL INTERSECTION	YR	YEAR
ELG	FLANGE FITTING				

SUMMARY OF QUANTITIES			
ITEM #	ITEM DESCRIPTION	UNIT	PLAN QUANTITY
001	MOBILIZATION / DEMOBILIZATION	LS	1
002	CLEARING AND GRUBBING	LS	1
003	60,000 GALLON WATER STORAGE TANK (UPPER SITE)	EA.	1
004	40,000 GALLON WATER STORAGE TANK (LOWER SITE)	EA.	1
005	CONCRETE RING FOUNDATION - TANK SUPPORT	EA.	
006	CONCRETE RETAINING WALL (HEIGHT VARIES)	L.F.	
007	MSE RETAINING WALL (HEIGHT VARIES)	L.F.	
008	CONNECT (N)6" DIP TO UPPER SITE (E)WATER STORAGE TANK	LS	
009	6" DIP SCH 80 WATERLINE	L.F.	
010	6" HDPE WATERLINE	L.F.	
011	6" HDPE WATERLINE - FH LATERALS	L.F.	
012	1" PE 3036 WATERLINE (LATERALS)	L.F.	
013	1 1/4" PE 3036 WATERLINE (LATERALS)	L.F.	
014	1" WATER METERS	EA.	
015	6" WATER FLOW METERS	EA.	
016	6" FLEX / EXPANSION JOINT	EA.	
017	6" FIRE HYDRANTS	EA.	
018	6" GATE VALVES - FH CONTROL	EA.	
019	6" GATE VALVES - TANK CONTROL	EA.	
020	6" GATE VALVES - WATER MAIN CONTROL	EA.	
21	BLOW-OFF VALVES	EA.	
22	6" DIP FITTINGS - FLANGED 90° ELBOWS	EA.	
23	6" HDPE FITTINGS - TEES 6x6x6	EA.	
24	6" HDPE FITTINGS - REDUCER 6x1 1/2	EA.	
25	6" HDPE FITTINGS - 22.5° ELBOWS	EA.	
26	6" HDPE FITTINGS - 45° ELBOWS	EA.	
27	6" HDPE FITTINGS - 90° ELBOWS	EA.	
31	CALTRANS D73B AREA DRN	EA.	
32	12" CMP CULVERT PIPE - UPPER TANK DRAIN	L.F.	
33	6" HDPE - LOWER TANK DRAIN	L.F.	
34	18" CMP DWY CULVERT PIPE	L.F.	
35	HOT MIX ASPHALT CONCRETE (HMAC) 150#/CU. FT. AT 2.5" THICK (DRIVEWAYS)	TON	
36	CLASS 2 AGGREGATE BASE (145#/ CU. FT.) (ACCESS ROAD GRAVEL OVERLAY)	TON	
37	1" CRUSHED ROCK - UPPER TANK (UNDER TANK FLOOR)	TON	
38	1" CRUSHED ROCK - LOWER TANK (UNDER TANK FLOOR)	TON	
39	1" CRUSHED ROCK AT UPPER TANK SITE TURNAROUND & SURROUNDING TANK	TON	
40	3" TO 8" COBBLE AT UPPER TANK DRAIN OUTLET	CU. YD.	
41	3" TO 8" COBBLE AT UPPER TANK DRAIN OUTLET	CU. YD.	
42	EROSION CONTROL	LS	

THE APPROXIMATE EARTHWORK QUANTITIES ARE AS FOLLOWS:		
SITE	EXCAVATION (CUT) CU. YDS.	EMBANKMENT (FILL) CU. YDS.
TANK SITE	TBD	TBD
TOTALS		

THE QUANTITIES FOR EARTHWORK ARE CALCULATED BY EXISTING & SUBGRADE SURFACE COMPARISON. NO ALLOWANCE HAS BEEN MADE FOR STRIPPINGS, KEYING AND BENCHING AND STORM DRAIN INSTALLATION. THESE QUANTITIES DO NOT INCLUDE OVEREXCAVATION. THESE QUANTITIES ARE BELIEVED TO BE ACCURATE, BUT NO ASSURANCE IS MADE THEREFORE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR FAMILIARIZING THEMSELVES AS TO THE TYPE, NATURE AND QUANTITIES OF MATERIALS TO BE EXCAVATED.

SURVEY LEGEND	
	FOUND MONUMENT (ALUMINUM CAP LS3577)
	FOUND SURVEY MONUMENT (GRIFFITH MON)
	REBAR (POE)
	SURVEY CONTROL POINT (SET NAIL)
	GPS OPUS CONTROL POINT (SET NAIL)

SURVEY NOTE

TOPOGRAPHY SURVEY BY TRINITY VALLEY CONSULTING ENGINEERS, INC.



TVCE
 TRINITY VALLEY CONSULTING ENGINEERS
 WILLOW CREEK, CA 95573
 PO BOX 1567
 67 WALNUT WAY
 FAX (530) 629-3011
 PHONE (530) 629-3000

PRELIMINARY

[illegible]

BRANNAN MOUNTAIN ROAD
WATER TANK
WILLOW CREEK COMMUNITY
SERVICES DISTRICT
135 WILLOW RD,
WILLOW CREEK, CA 95573

NOTES & QUANTITIES

DESIGN BY: EK

DRAWN BY: SG

CHECKED BY: EK

DATE:


3/28/25

SCALE: NO SCALE




PROJECT NO: 209.19

C2.0

C:\TVCE PROJECTS\BRANNAN MOUNTAIN WATER TANK\WG3.0 EXISTING SITE OVERVIEW.DWG

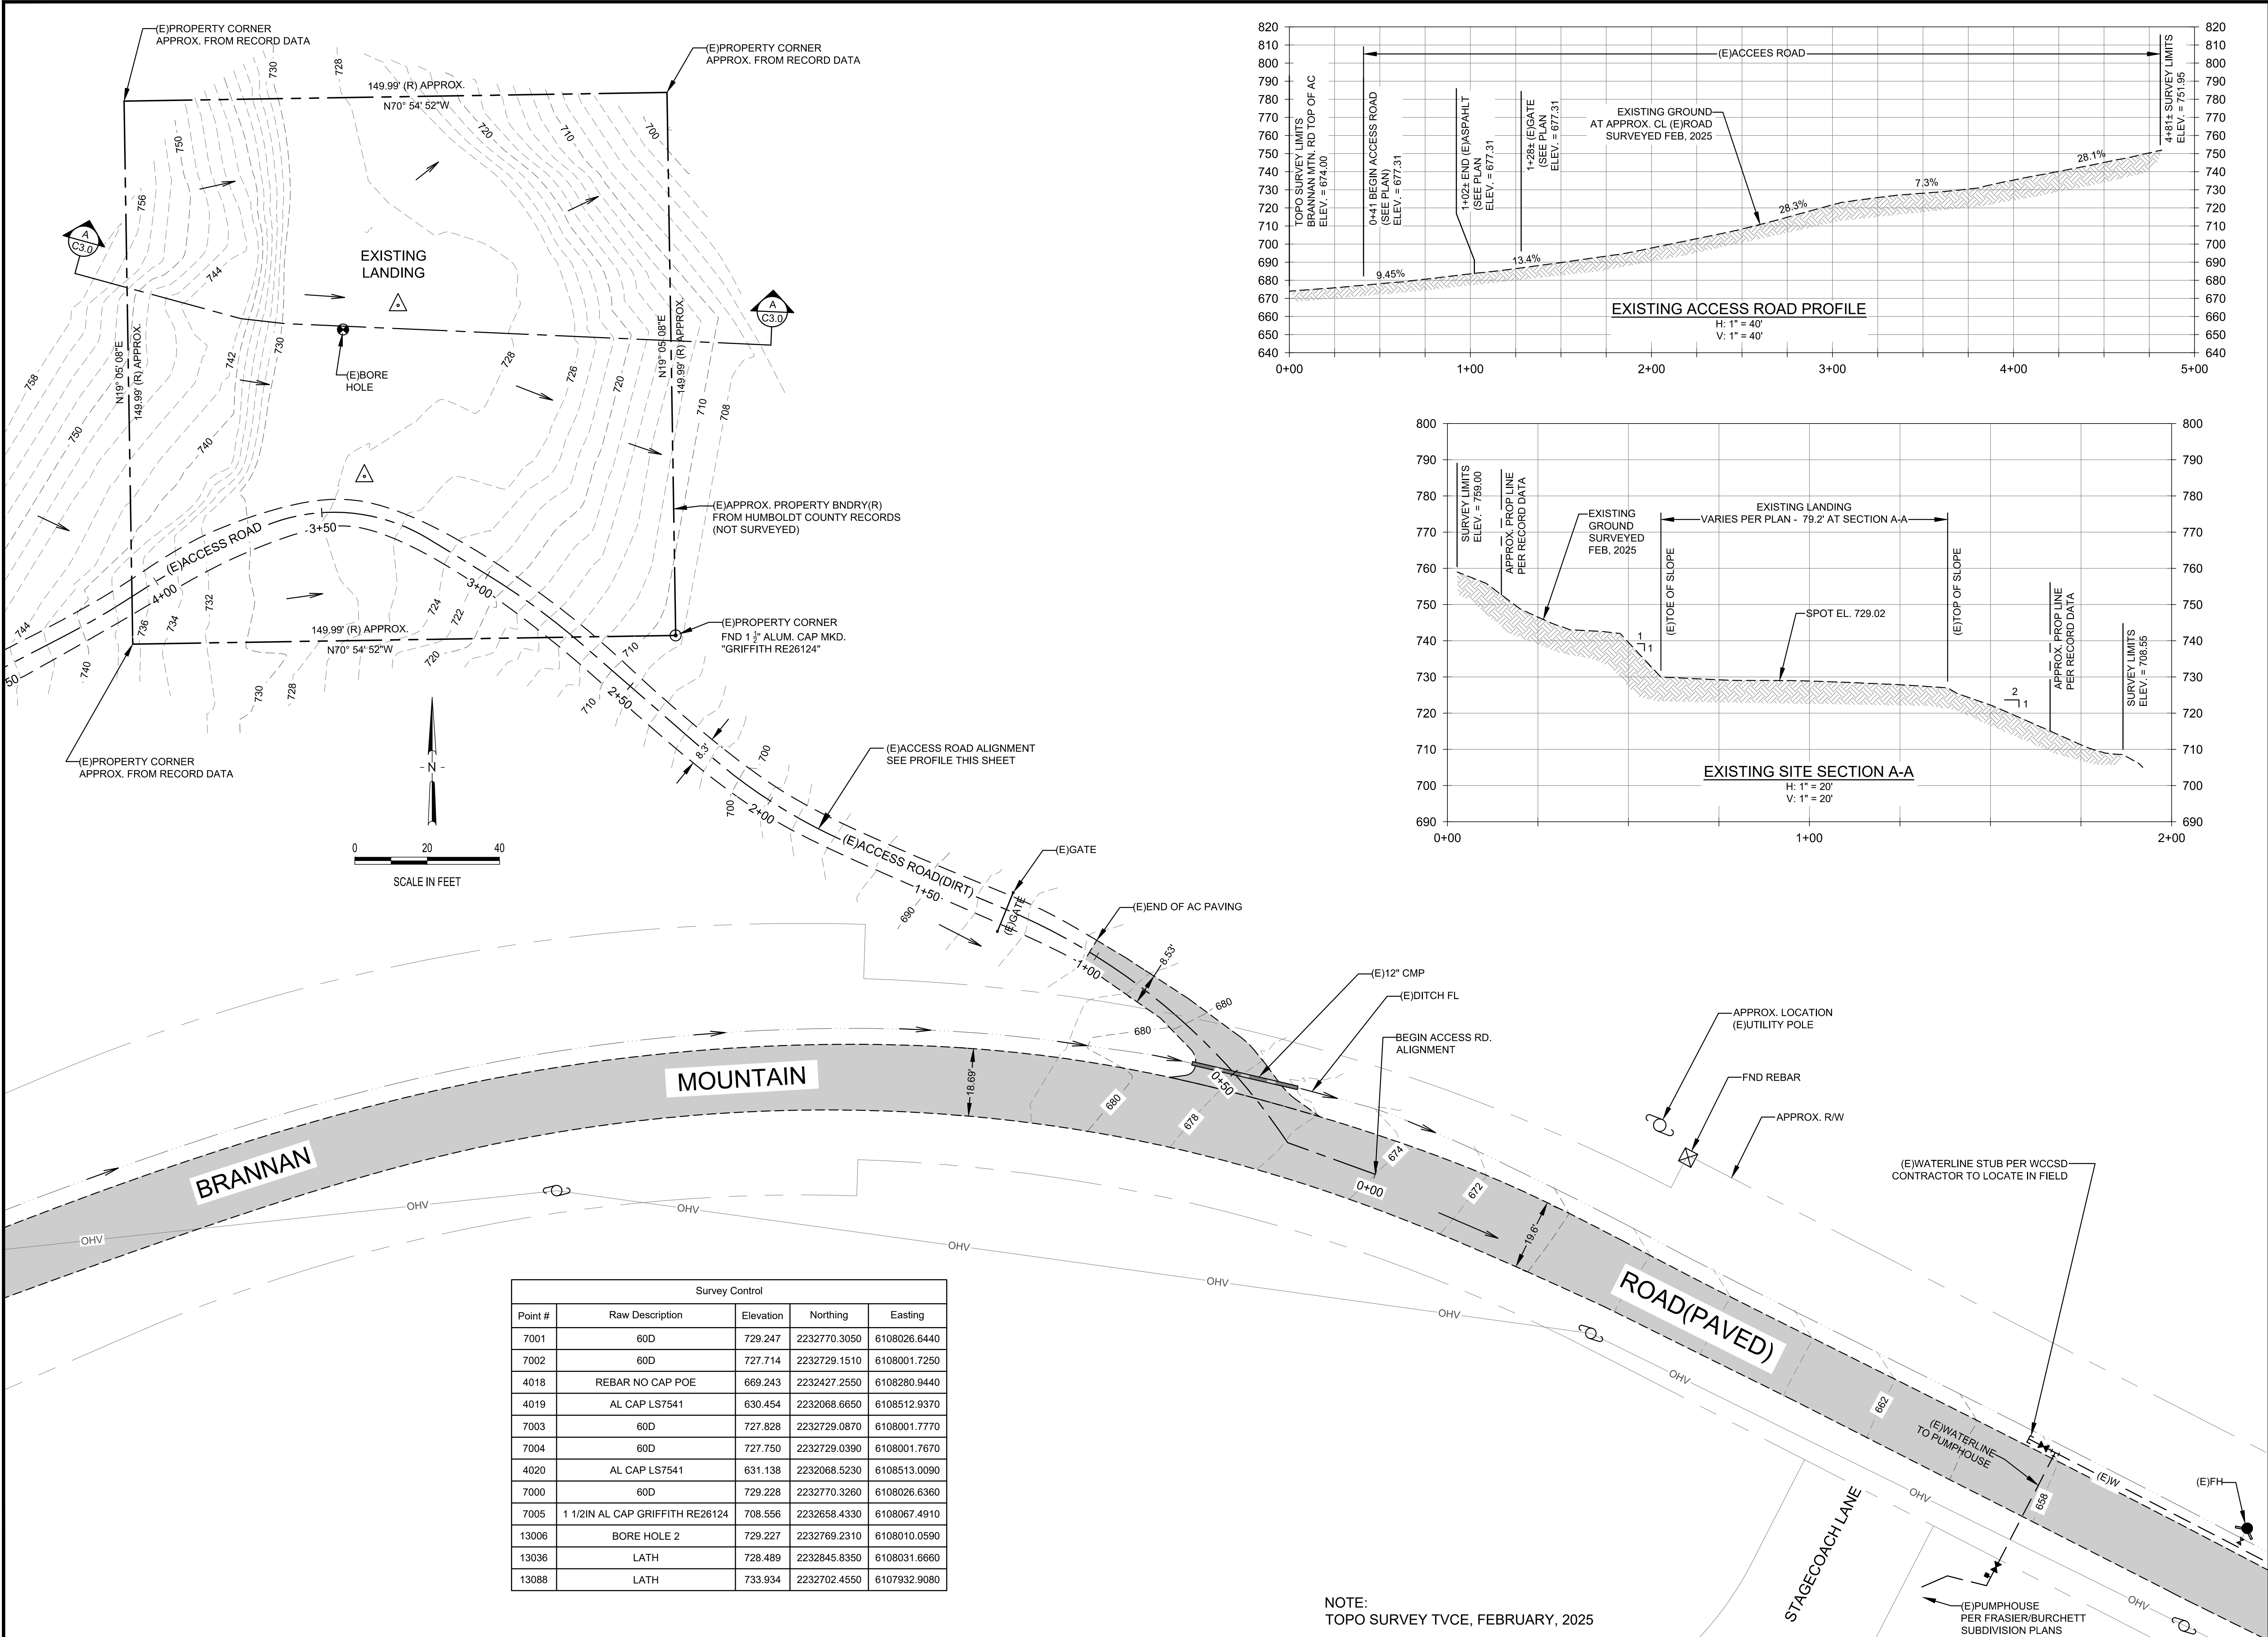

NOTE:
TOPO SURVEY TVCE, FEBRUARY, 2025

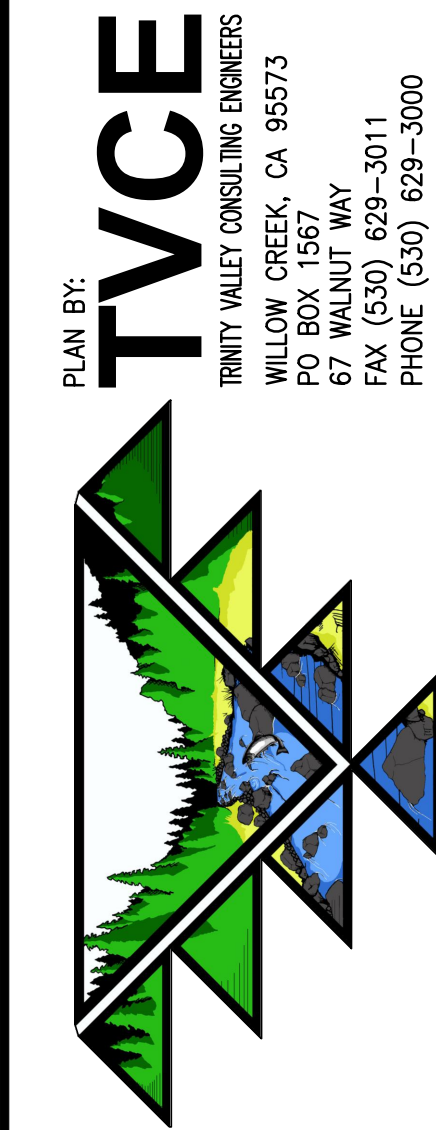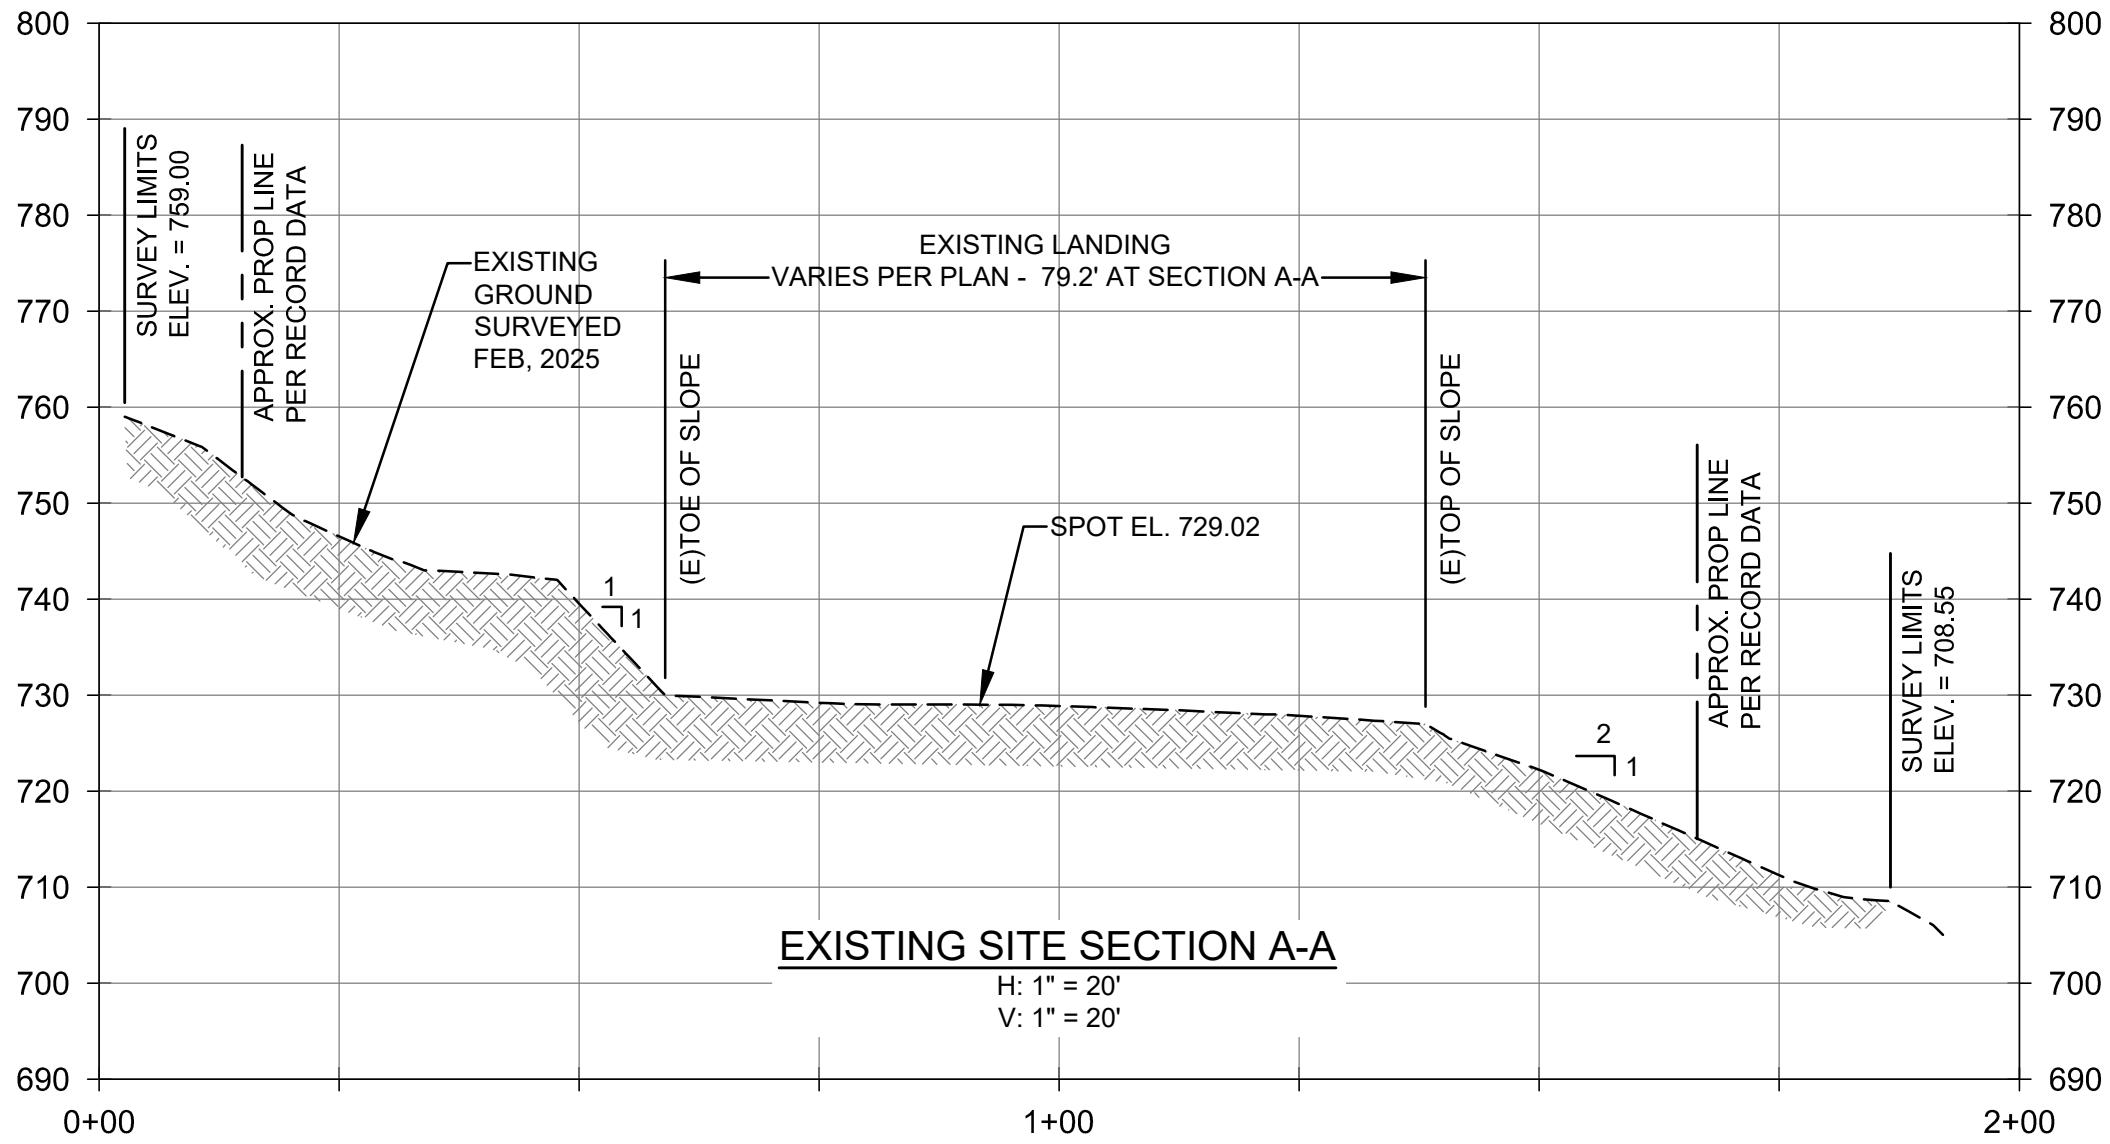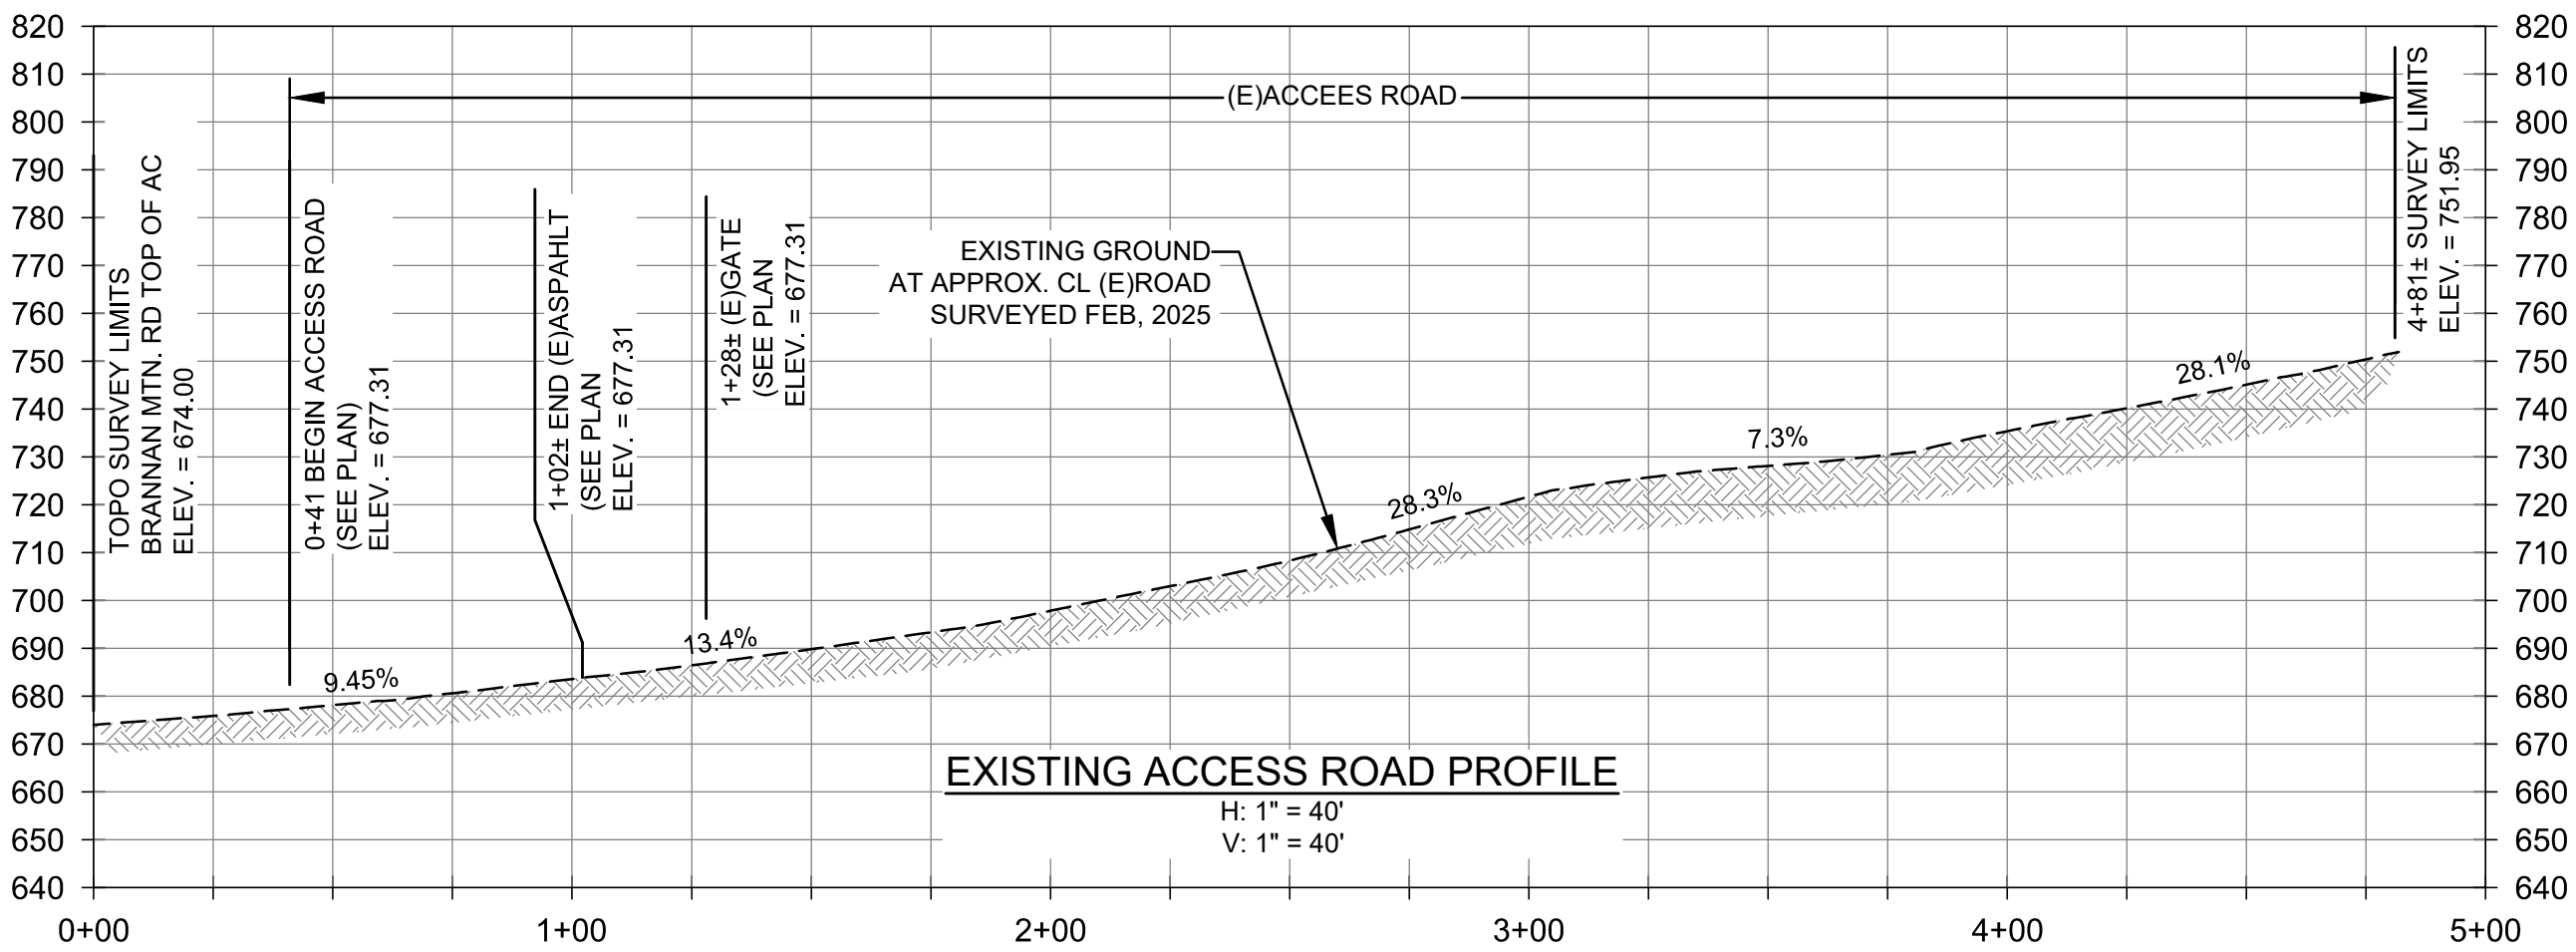

PRELIMINARY

REVISIONS

DATE:

NO.

BRANNAN MOUNTAIN ROAD
WATER TANK
WILLOW CREEK COMMUNITY
SERVICES DISTRICT
135 WILLOW RD,
WILLOW CREEK, CA 95573

EXISTING
SITE PLAN

DESIGN BY: EK

DRAWN BY: SG

CHECKED BY: EK

DATE:

4/7/25

SCALE: 1" = 20'

PROJECT NO: 209.19

C3.0

PRELIMINARY


[illegible]

BRANNAN MOUNTAIN ROAD
WATER TANK
WILLOW CREEK COMMUNITY
SERVICES DISTRICT
135 WILLOW RD,
WILLOW CREEK, CA 95573


PROPOSED SITE GRADING PLAN

DESIGN BY: EK
DRAWN BY: SG
CHECKED BY: EK
DATE: 4/6/25
SCALE: 1" = 8'
PROJECT NO: 209.19


C4.0

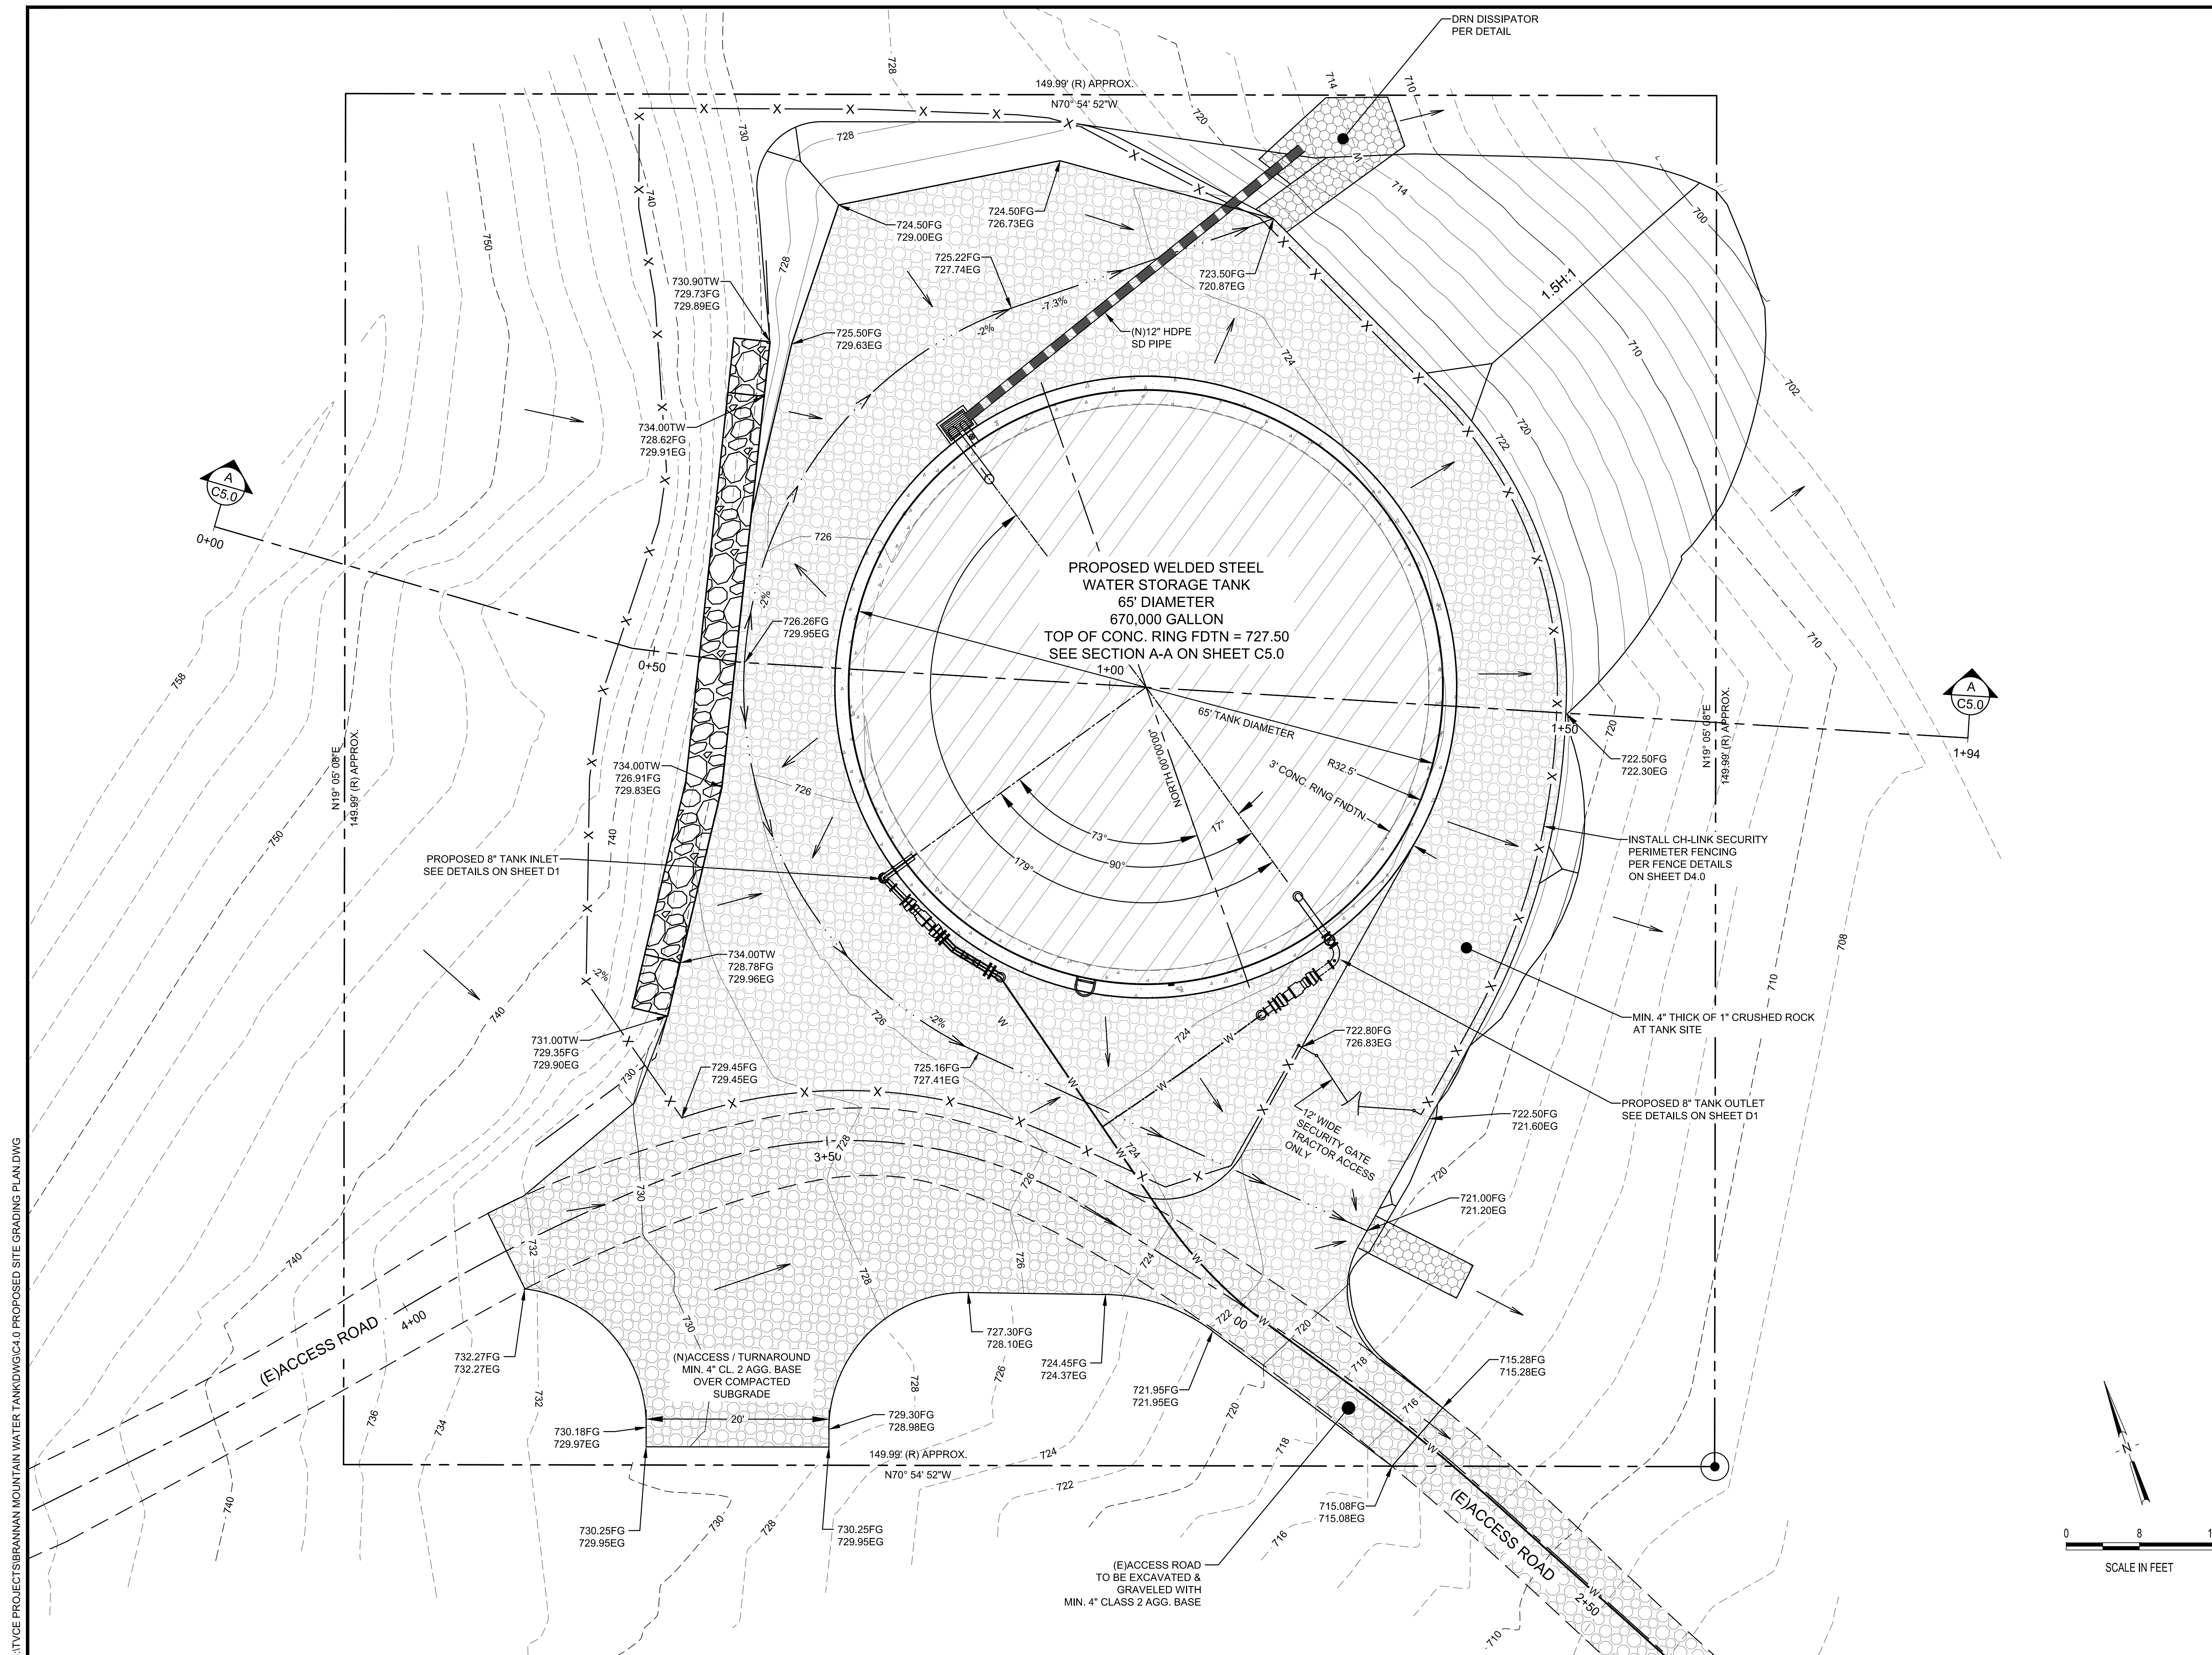

C:\TVCE PROJECTS\BRANNAN MOUNTAIN WATER TANK\DWG\C5.0 PROPOSED SITE SECTIONS.DWG

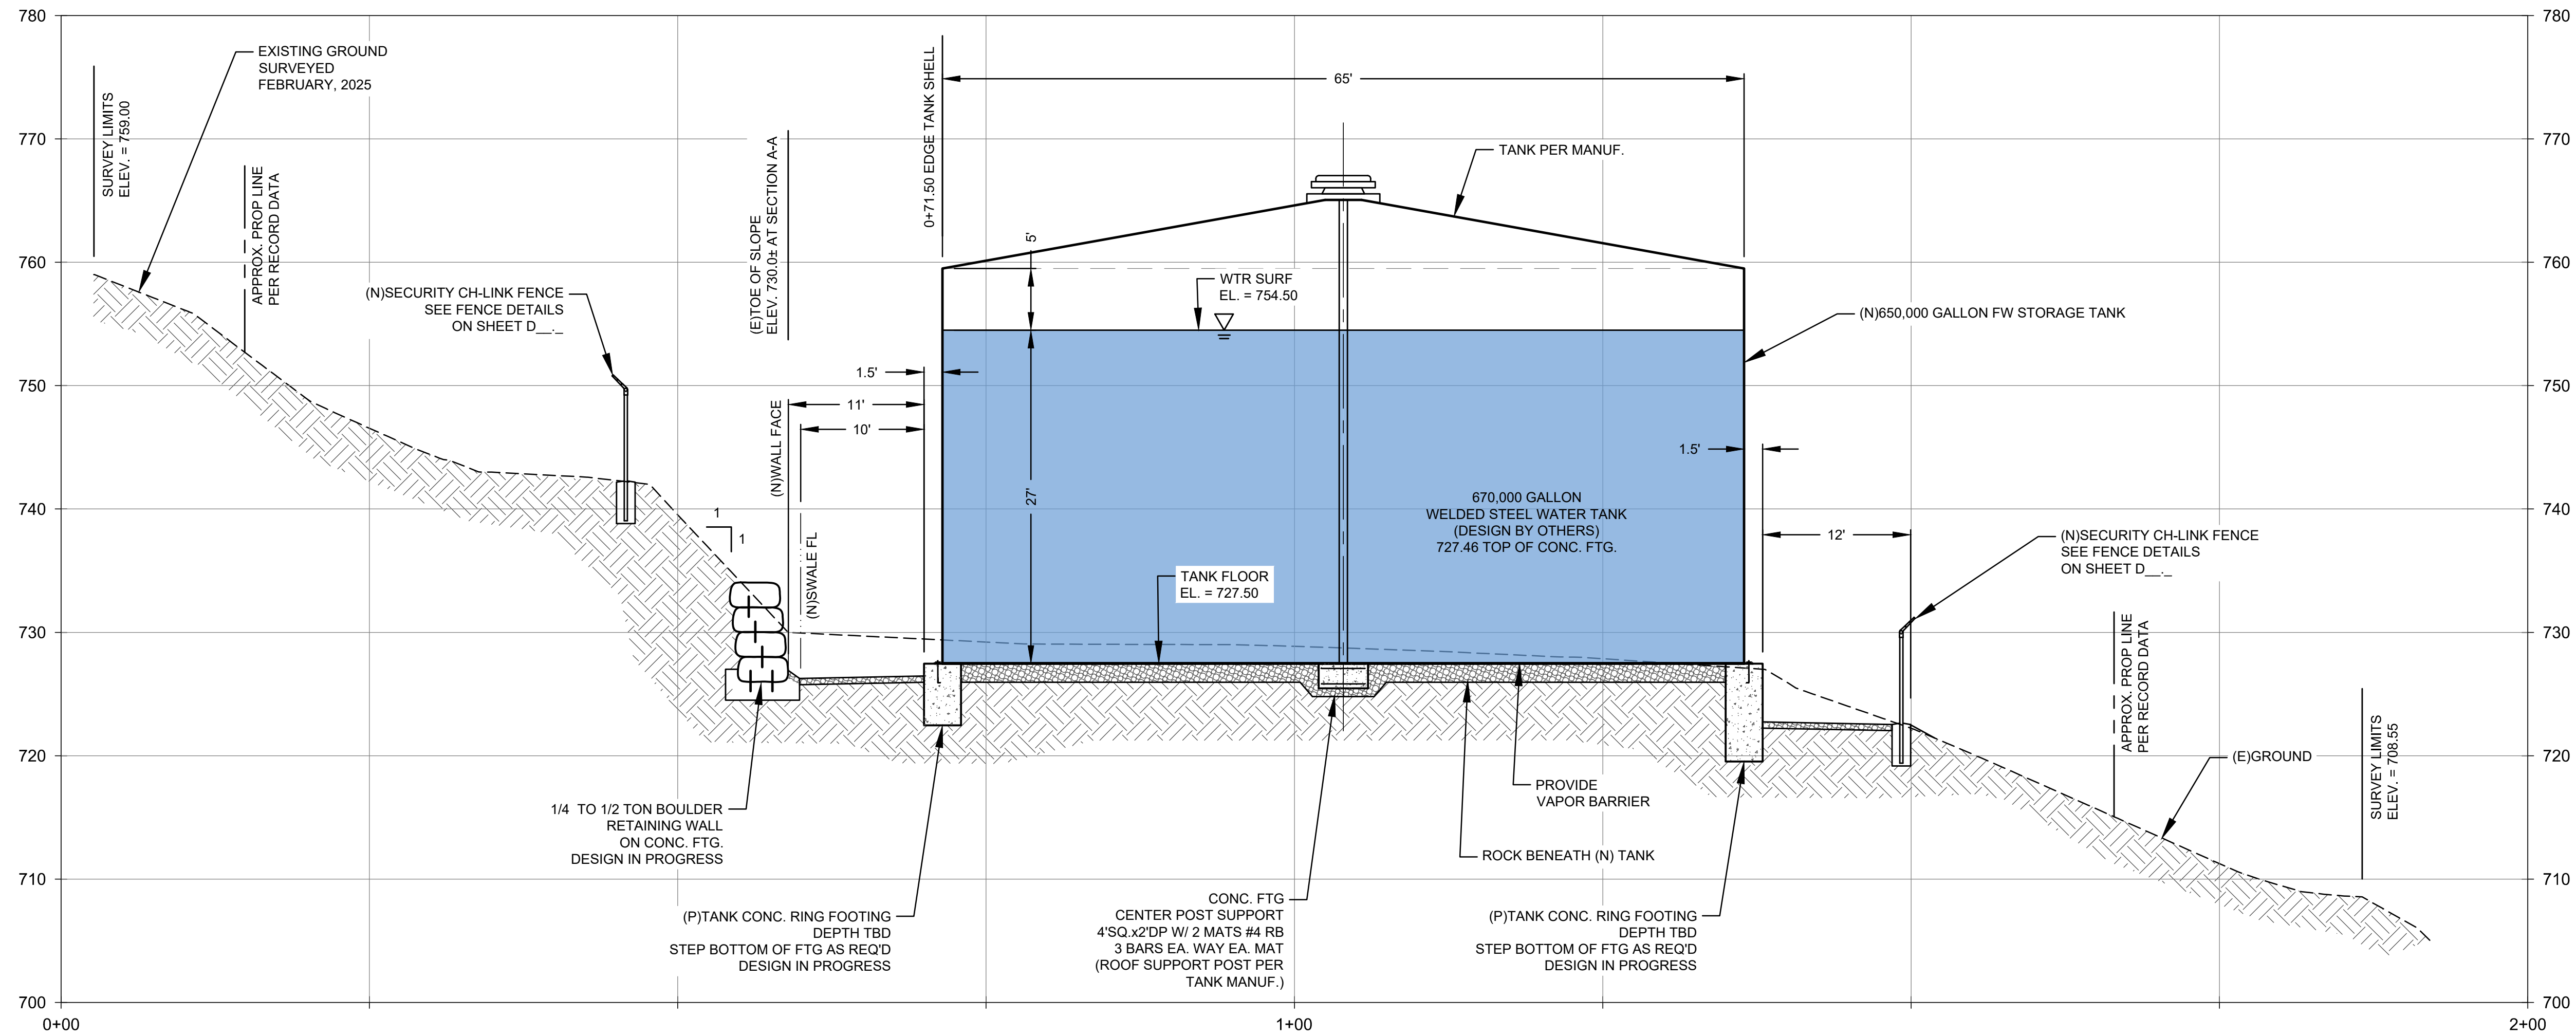

PROPOSED SITE SECTION A-A
H: 1" = 8'
V: 1" = 8'

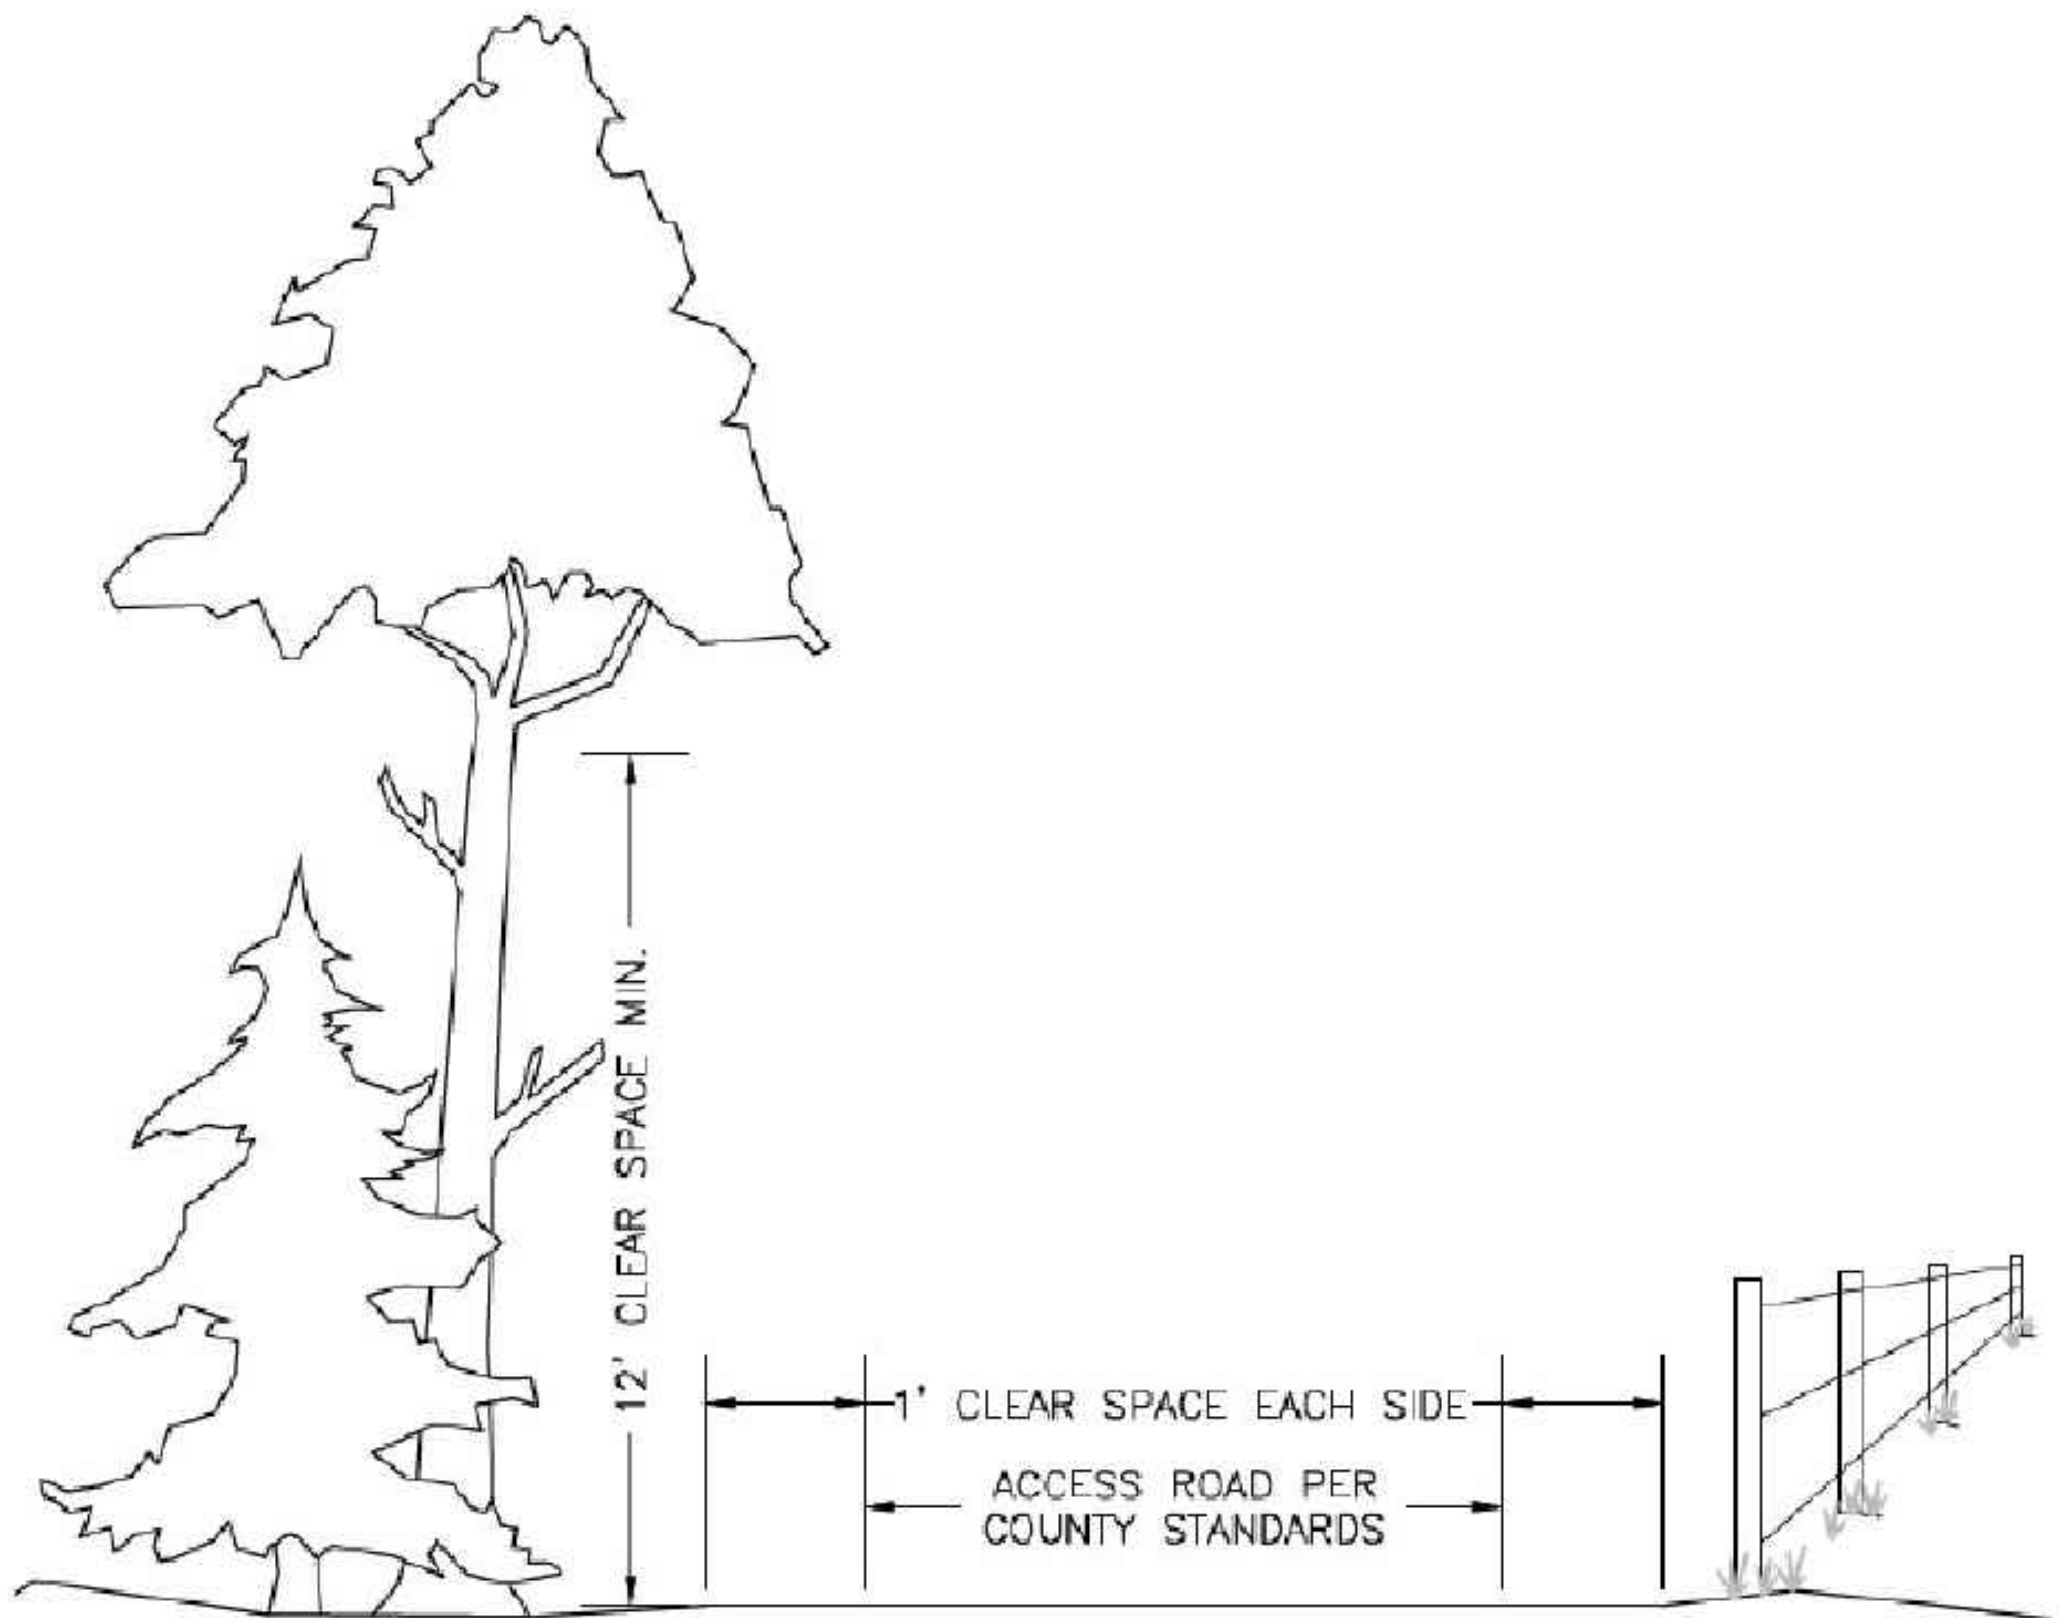

ACCESS ROAD CLEARANCE SECTION
NTS



PLAN BY: TVCE
TRINITY VALLEY CONSULTING ENGINEERS
WILLOW CREEK, CA 95573
PO BOX 1567
67 WALNUT WAY
FAX (530) 629-3011
PHONE (530) 629-3000

PRELIMINARY

NO.	DATE:	REVISIONS



BRANNAN MOUNTAIN ROAD
WATER TANK
WILLOW CREEK COMMUNITY
SERVICES DISTRICT
135 WILLOW RD,
WILLOW CREEK, CA 95573

PROPOSED SITE
GRADING SECTIONS

DESIGN BY: EK
DRAWN BY: SG
CHECKED BY: EK
DATE: 4/7/25
SCALE: AS SHOWN
PROJECT NO: 209.19

C5.0

C:\TVCE PROJECTS\BRANNAN MOUNTAIN WATER TANK\DWG\C6.0 PROPOSED RETAINING WALL PLAN & PROFILE.DWG

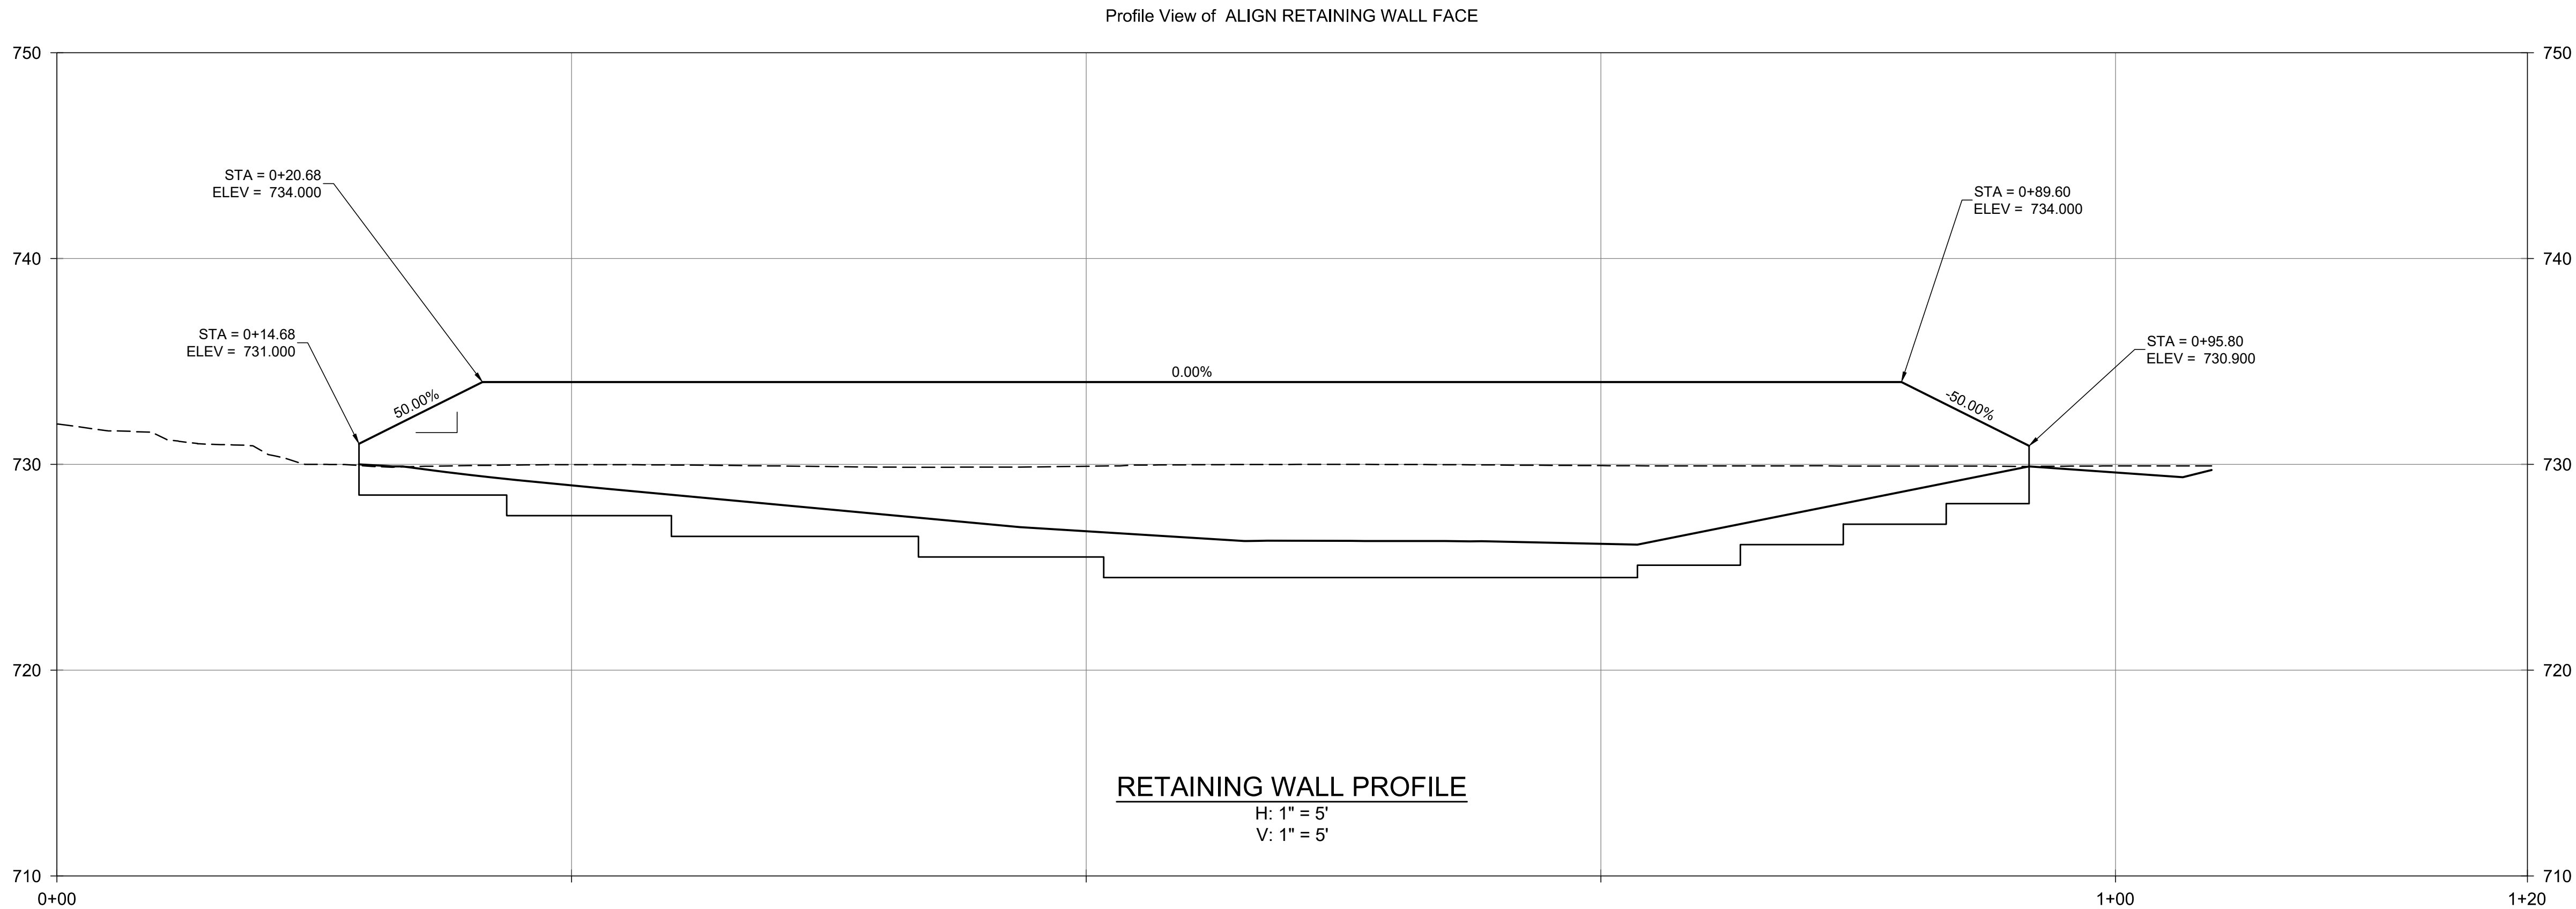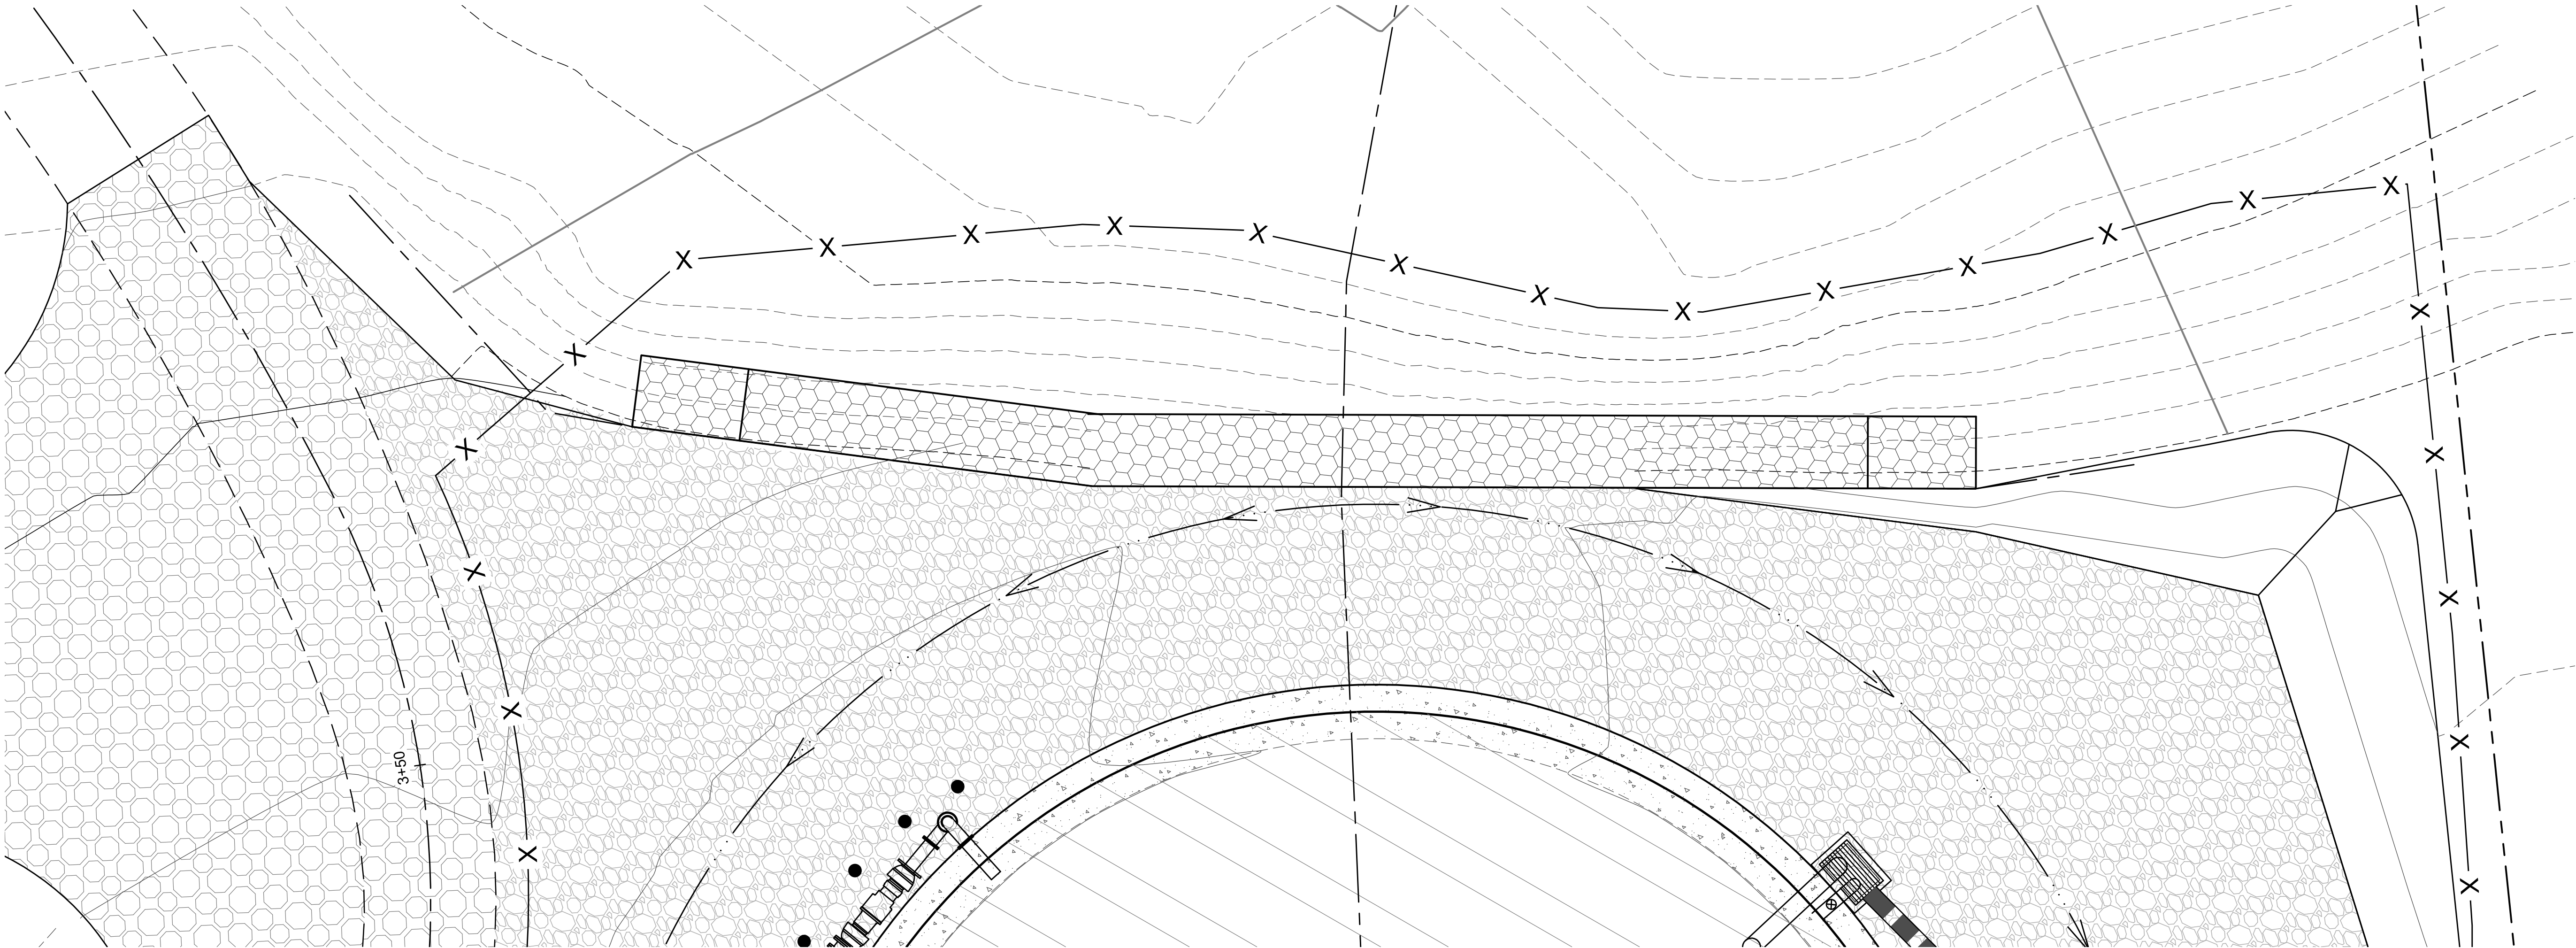

PRELIMINARY

NO.	REVISIONS	DATE:

BRANNAN MOUNTAIN ROAD
WATER TANK
WILLOW CREEK COMMUNITY
SERVICES DISTRICT
135 WILLOW RD,
WILLOW CREEK, CA 95573

RETAINING WALL
PLAN & PROFILE

DESIGN BY: EK

DRAWN BY: SG

CHECKED BY: EK


DATE: 4/7/25

SCALE: AS SHOWN

PROJECT NO: 209.19

C6.0

C:\TVCE PROJECTS\BRANNAN MOUNTAIN WATER TANK\DWG\C8.0 PROCESS DIAGRAM.DWG

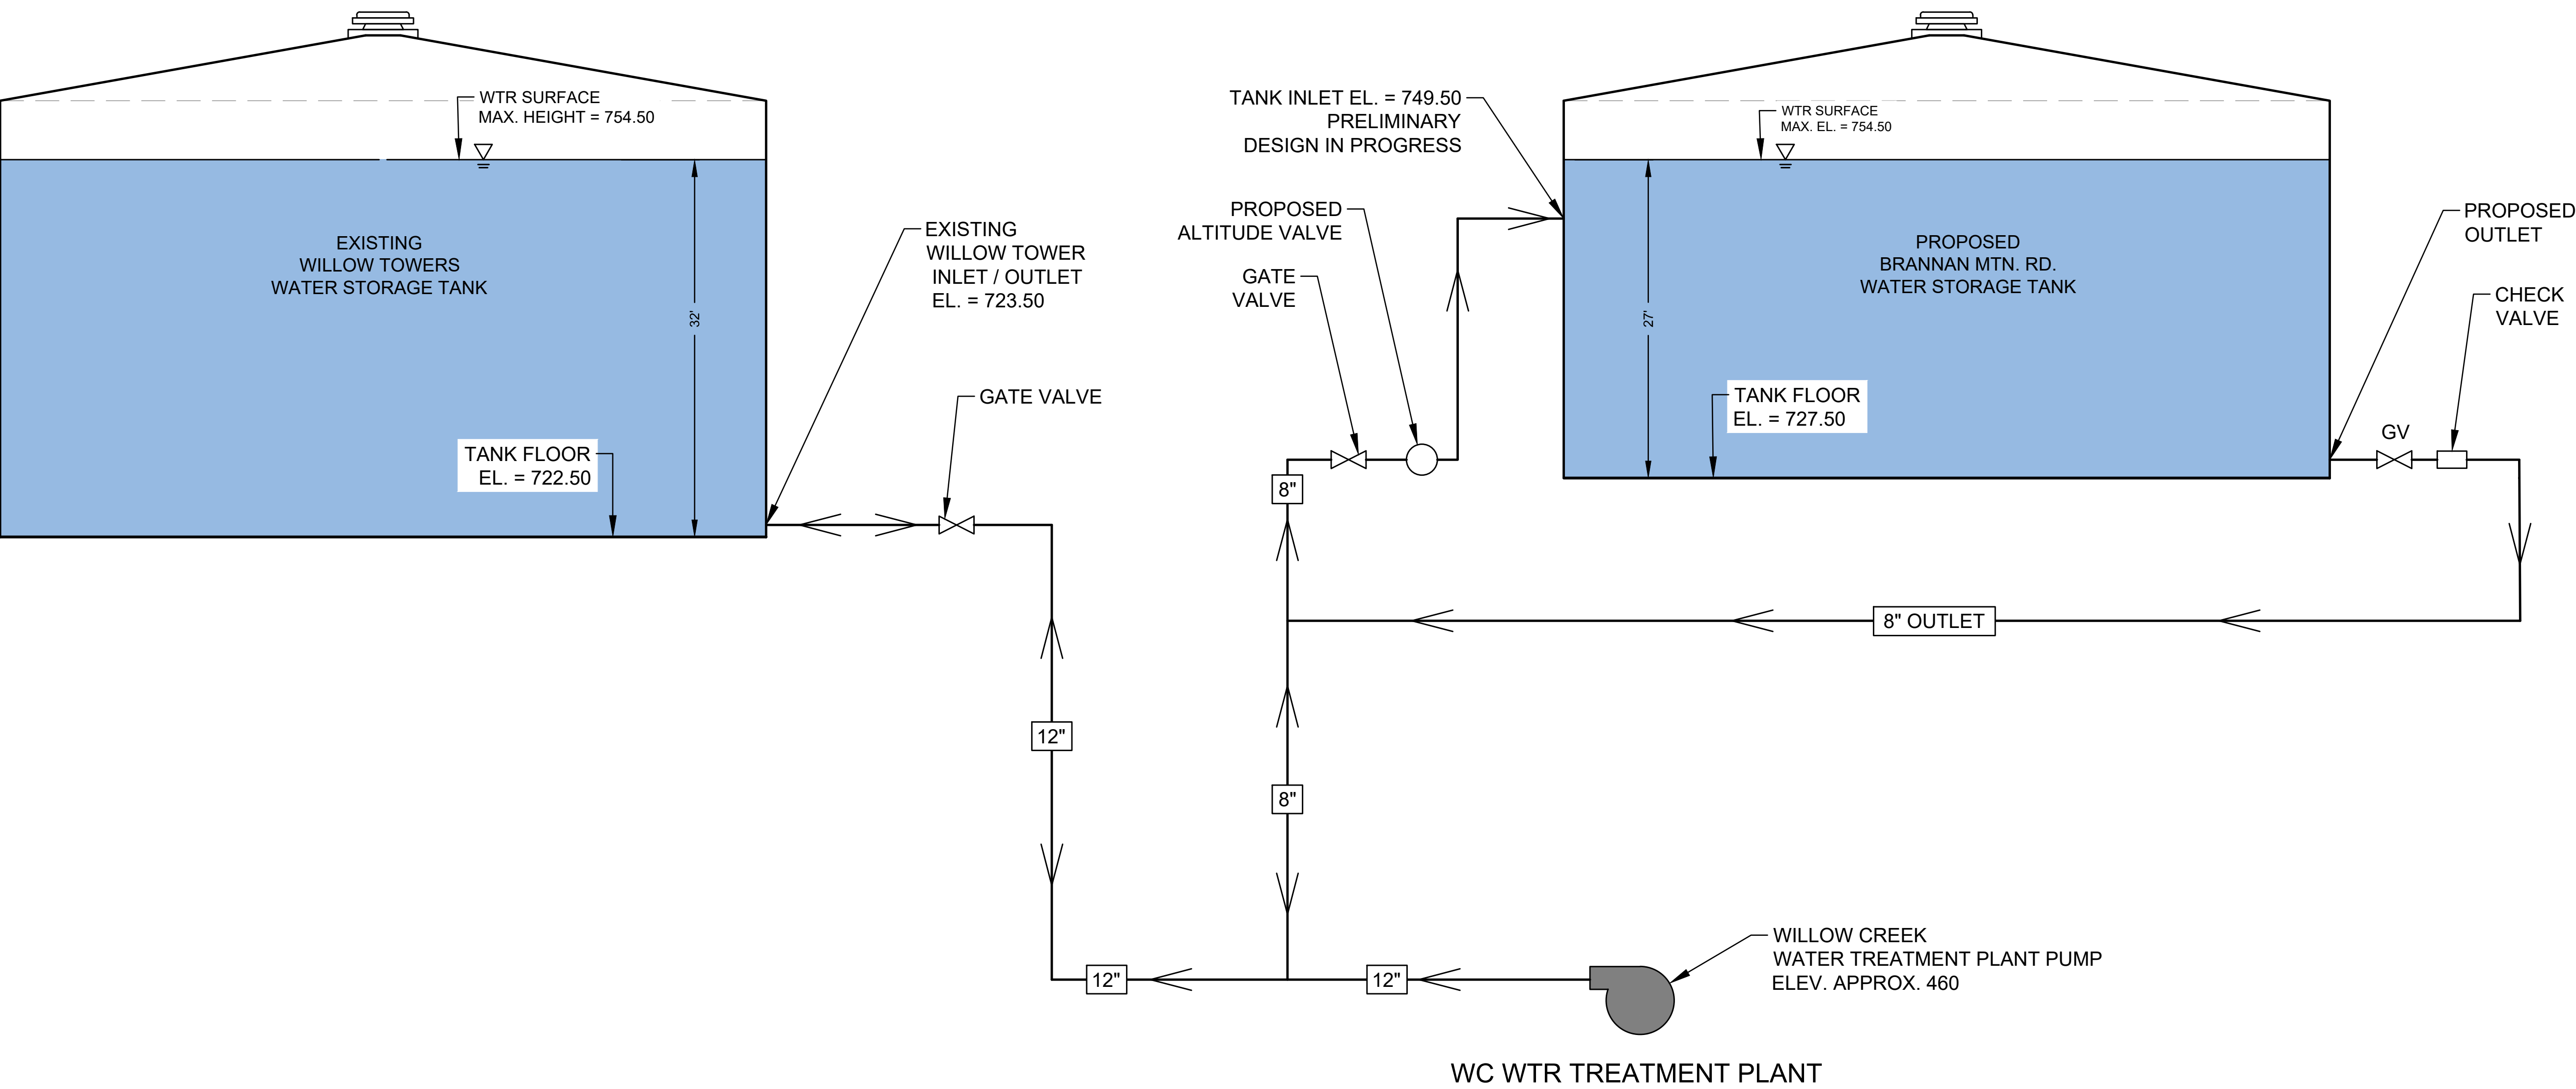

PLAN BY:
TVCE
TRINITY VALLEY CONSULTING ENGINEERS
WILLOW CREEK, CA 95573
PO BOX 1567
67 WALNUT WAY
FAX (530) 629-3011
PHONE (530) 629-3000

PRELIMINARY

NO.	REVISIONS					DATE:

BRANNAN MOUNTAIN ROAD
WATER TANK
WILLOW CREEK COMMUNITY
SERVICES DISTRICT
135 WILLOW RD,
WILLOW CREEK, CA 95573

PROCESS
DIAGRAM

DESIGN BY: EK

DRAWN BY: SG


CHECKED BY: EK

DATE: 4/7/25

SCALE: NTS

PROJECT NO: 209.19

C8.0

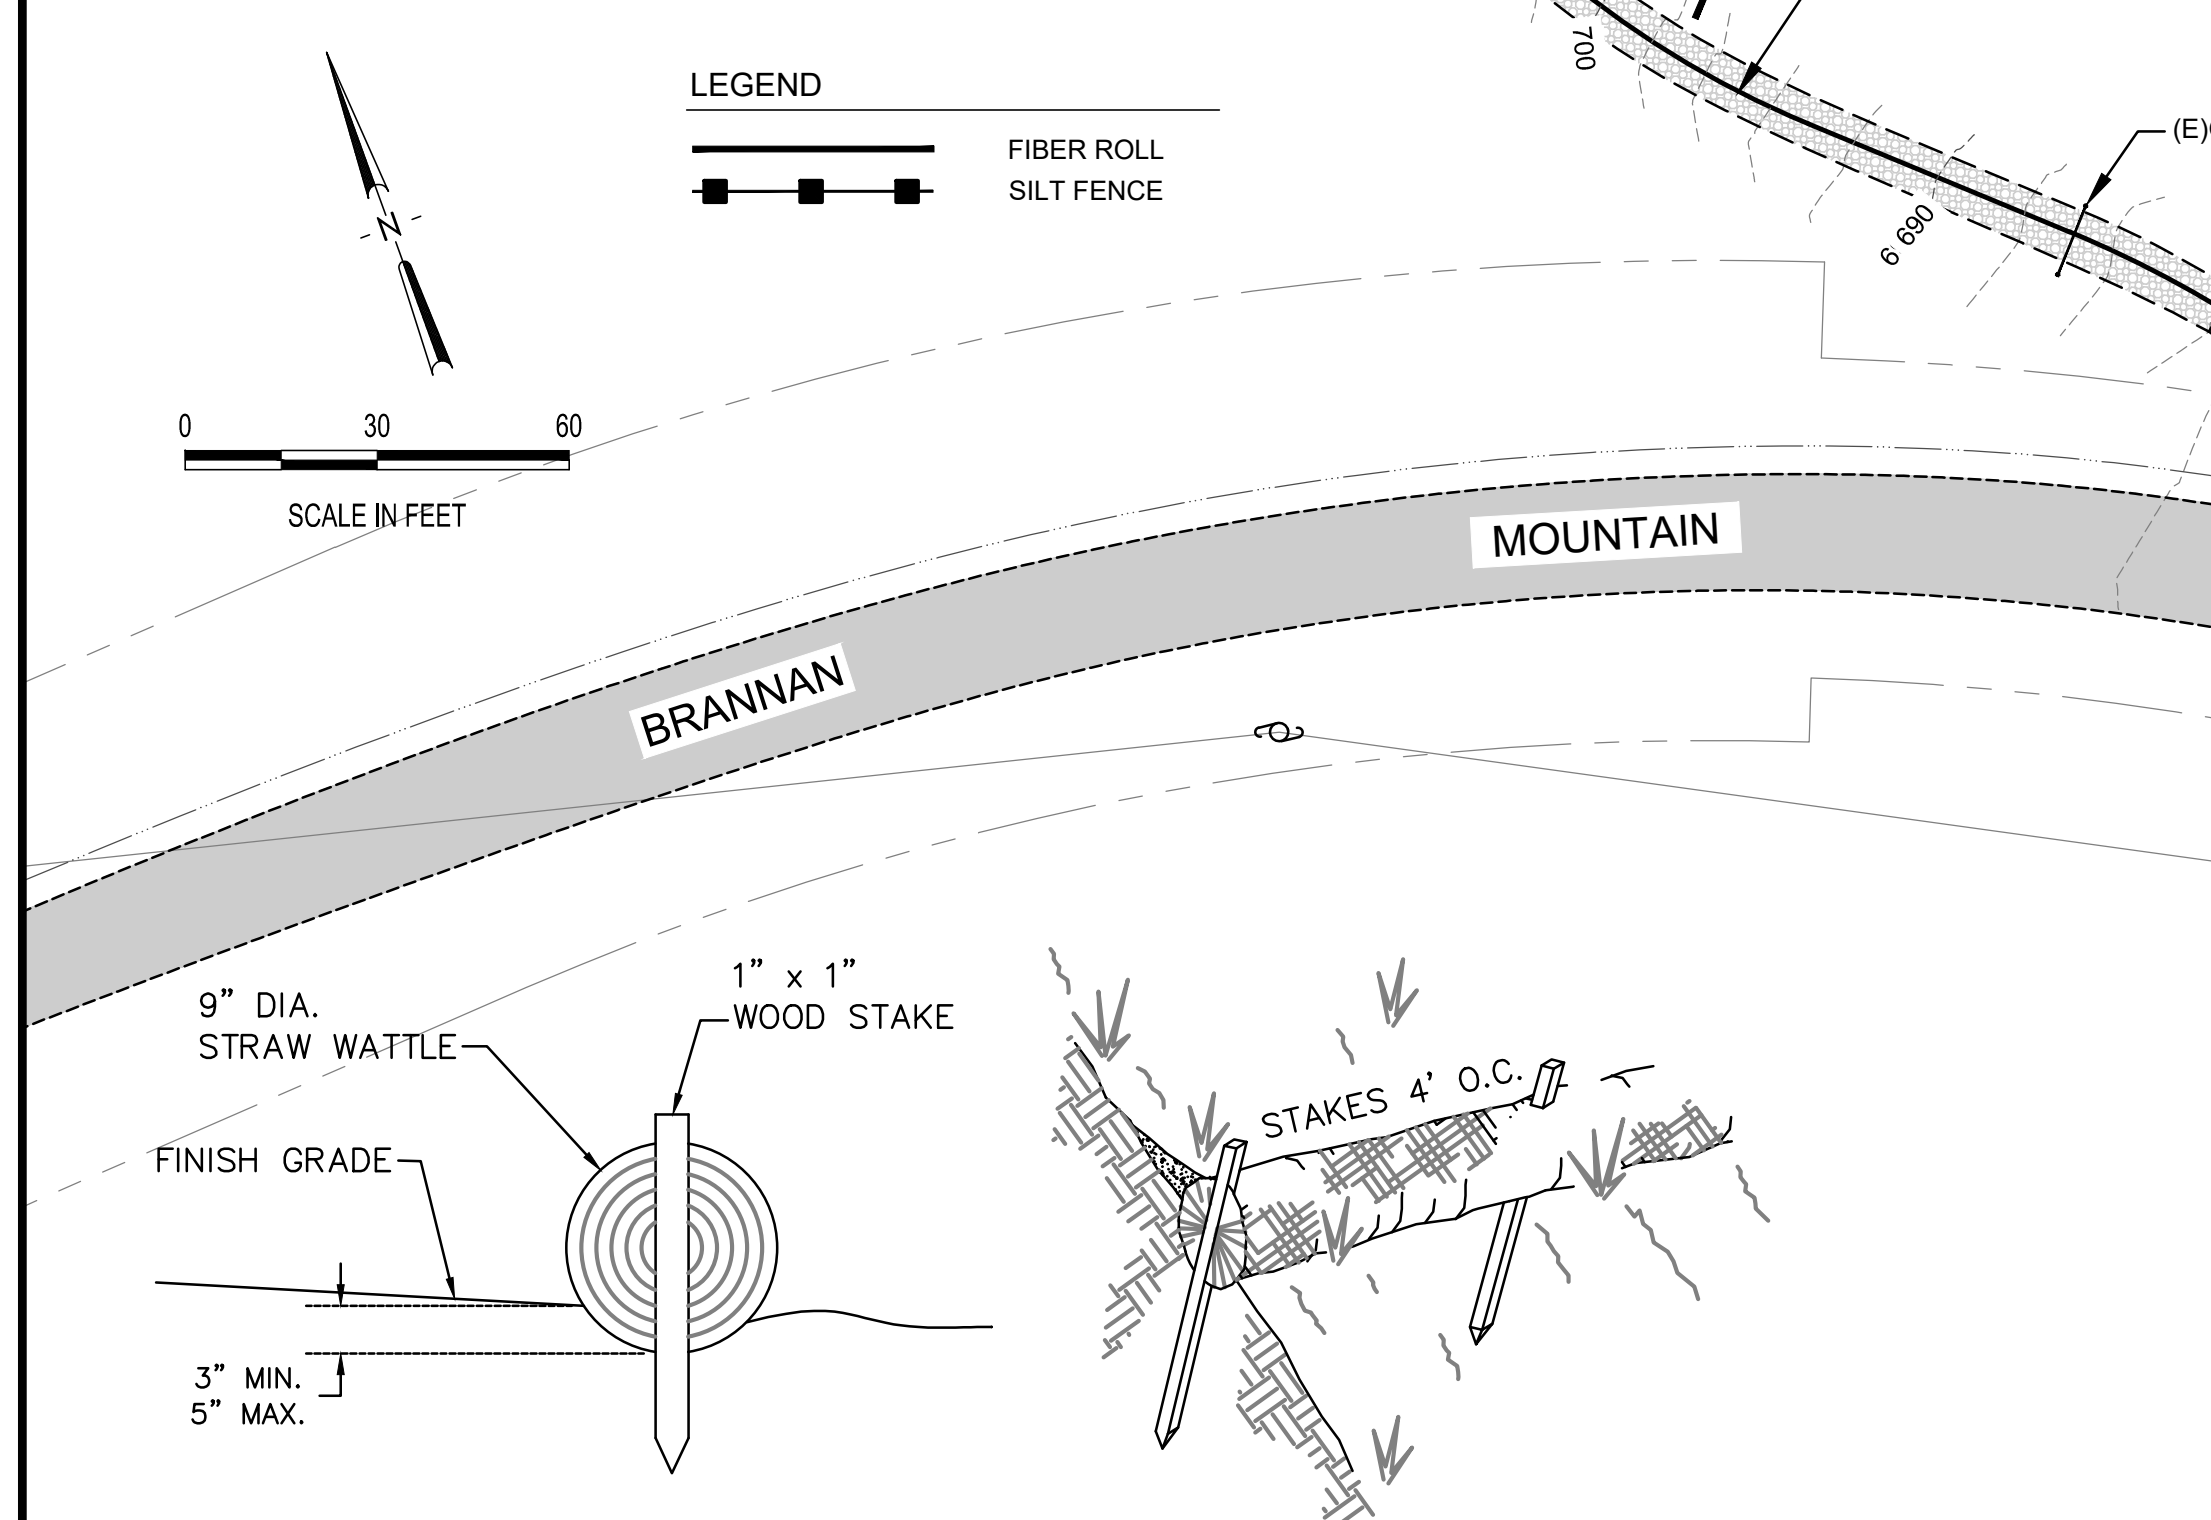

1. STRAW SHALL BE DERIVED FROM WHEAT, RICE, OR BARLEY, WHERE REQUIRED BY THE PLANS, SPECIFICATIONS, PERMITS, OR ENVIRONMENTAL DOCUMENTS, NATIVE GRASS STRAW SHALL BE USED.
2. A TACKIFIER IS THE PREFERRED METHOD FOR ANCHORING STRAW MULCH TO THE SOIL ON SLOPES.
3. CRIMPING, PUNCH ROLLER-TYPE ROLLERS, OR TRACK WALKING MAY ALSO BE USED TO INCORPORATE STRAW MULCH INTO THE SOIL ON SLOPES. TRACK WALKING SHALL ONLY BE USED WHERE OTHER METHODS ARE IMPRACTICAL.
4. AVOID PLACING STRAW ONTO ROADS, SIDEWALKS, DRAINAGE CHANNELS, SOUND WALLS, EXISTING VEGETATION, ETC.
5. STRAW MULCH WITH TACKIFIER SHALL NOT BE APPLIED DURING OR IMMEDIATELY BEFORE RAINFALL.
6. APPLY STRAW AT A MINIMUM RATE OF 4,000 LB/ACRE, EITHER BY MACHINE OR BY HAND DISTRIBUTION.
7. ROUGHEN EMBANKMENTS AND FILL RILLS BEFORE PLACING THE STRAW MULCH BY ROLLING WITH A CRIMPING OR PUNCHING TYPE ROLLER OR BY TRACK WALKING.
8. EVENLY DISTRIBUTE STRAW MULCH ON THE SOIL SURFACE.
9. ON SMALL AREAS, A SPADE OR SHOVEL CAN BE USED TO PUNCH IN STRAW MULCH.
10. ON SLOPES WITH SOILS THAT ARE STABLE ENOUGH AND OF SUFFICIENT GRADIENT TO SAFELY SUPPORT CONSTRUCTION EQUIPMENT WITHOUT CONTRIBUTING TO COMPACTION AND INSTABILITY PROBLEMS, STRAW CAN BE "PUNCHED" INTO THE GROUND USING A KNIFE BLADE ROLLER OR A STRAIGHT BLADED COULTER, KNOWN COMMERCIALY AS A "CRIMPER".
11. ON SMALL AREAS AND/OR STEEP SLOPES, STRAW CAN ALSO BE HELD IN PLACE USING JUTE. THE NETTING SHALL BE HELD IN PLACE USING 11 GAUGE WIRE STAPLES, GEOTEXTILE PINS OR WOODEN STAKES AS DESCRIBED IN EC-7, GEOTEXTILES AND MATS.
12. TACKIFIER ACTS TO GLUE THE STRAW FIBERS TOGETHER AND TO THE SOIL SURFACE. THE TACKIFIER SHALL BE SELECTED BASED ON LONGEVITY AND ABILITY TO HOLD THE FIBERS IN PLACE. A TACKIFIER IS TYPICALLY APPLIED AT A RATE OF 125 LB/ACRE. IN WINDY CONDITIONS, THE RATES ARE TYPICALLY 180LB/ACRE.

1. EROSION CONTROL BEST MANAGEMENT PRACTICES (BMP'S) SHALL BE INSTALLED AND MAINTAINED DURING THE WET SEASON (OCTOBER 1 THROUGH APRIL 30). SEDIMENT CONTROL BMP'S SHALL BE INSTALLED AND MAINTAINED ALL YEAR.
2. ALL DRAINAGE INLETS IMMEDIATELY DOWNSTREAM OF THE WORK AREA AND WITHIN THE WORK AREA SHALL BE PROTECTED WITH SEDIMENT CONTROL AND INLET FILTER BAGS, YEAR ROUND.
3. ALL STABILIZED CONSTRUCTION ACCESS LOCATIONS SHALL BE CONSTRUCTED PER STANDARD DRAWING TC-1 WHERE CONSTRUCTION TRAFFIC ENTERS OR LEAVES PAVED AREAS. THE STABILIZED ACCESS SHALL BE MAINTAINED ON A YEAR-ROUND BASIS UNTIL THE COMPLETION OF CONSTRUCTION.
4. ALL AREAS DISTURBED DURING CONSTRUCTION, BY GRADING, TRENCHING, OR OTHER ACTIVITIES, SHALL BE PROTECTED FROM EROSION DURING THE WET SEASON (OCTOBER 1 THROUGH APRIL 30). HYDROSEED, IF UTILIZED, MUST BE PLACED BY SEPTEMBER 15. HYDROSEED PLACED DURING THE WET SEASON SHALL USE A SECONDARY EROSION PROTECTION METHOD.
5. SENSITIVE AREAS AND AREAS WHERE EXISTING VEGETATION IS BEING PRESERVED SHALL BE PROTECTED WITH CONSTRUCTION FENCING. SEDIMENT CONTROL BMP'S SHALL BE INSTALLED WHERE ACTIVE CONSTRUCTION AREAS DRAIN INTO SENSITIVE OR PRESERVED VEGETATION AREAS.
6. SEDIMENT CONTROL BMP'S SHALL BE PLACED ALONG THE PROJECT PERIMETER WHERE DRAINAGE LEAVES THE PROJECT. SEDIMENT CONTROL BMP'S SHALL BE MAINTAINED YEAR-ROUND UNTIL THE CONSTRUCTION IS COMPLETE OR THE DRAINAGE PATTERN HAS BEEN CHANGED AND NO LONGER LEAVES THE SITE.
7. ALL SLOPES GREATER THAN 1:1 SHALL RECEIVE SEED AND STRAW OR OTHER EROSION CONTROL.
8. ALL FENCING AND EROSION CONTROL METHODS SHALL BE MAINTAINED THROUGHOUT ALL ON-SITE CONSTRUCTION ACTIVITIES.
9. ALL BMPS SHALL BE INSTALLED AND FUNCTIONING PRIOR TO ANY ANTICIPATED STORM EVENT.

1. THE INFORMATION ON THESE DRAWINGS ARE ACCURATE FOR WATER POLLUTION CONTROL PURPOSES ONLY.
2. THE INFORMATION ON THIS PLAN IS INTENDED TO BE USED AS A GUIDELINE FOR THE CONTRACTOR AND SUBCONTRACTORS TO INSTALL WATER POLLUTION CONTROL DEVICES AT GENERAL LOCATION THROUGHOUT THE SITE. THESE DRAWINGS ARE TO BE USED IN CONJUNCTION WITH THE NARRATIVE SECTION OF THE WATER POLLUTION CONTROL PLAN.
3. FIELD CONDITIONS MAY NECESSITATE MODIFICATION TO THESE DRAWINGS.
4. PERMANENT EROSION CONTROL AND REVEGETATION WILL BE INSTALLED AS AREAS ARE DETERMINED TO BE SUBSTANTIALLY COMPLETE AND PER THE SPECIFICATIONS.
5. ALL BMPs WILL BE FIELD-VERIFIED AND APPROVED FOR INSTALLATION BY THE RE. ALL BMPs WILL BE INSTALLED ACCORDING TO THE STANDARD PLANS AND SPECIFICATIONS UNLESS APPROVED BY THE RE AND AMENDED INTO THE WPCP.

1. ALL OF THE IMPLEMENTED BMPS SHALL BE INSPECTED AND CORRECTED AS NEEDED PRIOR TO, DURING, AND DIRECTLY FOLLOWING ANY STORM EVENT, OR WHENEVER PRACTICAL.

1. STRAW WATTLES SHALL BE INSTALLED WITH 18 OR 24 INCH WOOD STAKES AT FOUR FEET ON CENTER. THE ENDS OF ADJACENT STRAW WATTLES SHALL BE ABUTTED TO EACH OTHER SNUGLY OR OVERLAPPED BY SIX INCHES.
2. STRAW ROLL INSTALLATION REQUIRES THE PLACEMENT AND SECURE STAKING OF THE ROLL IN A TRENCH, 3"-5" DEEP. RUNOFF MUST NOT BE ALLOWED TO RUN UNDER OR AROUND THE ROLL.

Diagram illustrating the construction of a trench for filter fabric installation. Key dimensions and components include:

- STEEL OR WOOD POST 36" HIGH MAX
- 9" MAX STORAGE HT.
- 24" MIN.
- PONDING HT.
- ATTACH FILTER FABRIC SECURELY TO UPSTREAM SIDE OF POST
- 8"
- 12"
- 8"x12" TRENCH WITH COMPACTED BACKFILL
- RUNOFF
- EXTRA STRENGTH FILTER FABRIC WITHOUT WIRE MESH SUPPORT
- STEEL OR WOOD POSTS
- 10 FT MAX SPACING WITH WIRE SUPPORT FENCE 6 FT MAX SPACING WITHOUT WIRE SUPPORT FENCE
- FLOW

1. THE CONTRACTOR SHALL INSPECT AND REPAIR FENCE AFTER EACH STORM EVENT.
2. CONTRACTOR SHALL REMOVE SEDIMENT AS NECESSARY. REMOVED SEDIMENT SHALL BE DEPOSITED TO AN AREA THAT WILL NOT CONTRIBUTE SEDIMENT OFF-SITE AND IN AN AREA THAT CAN BE PERMANENTLY STABILIZED.
3. SILT FENCE SHALL BE PLACED ON SLOPE CONTOURS TO MAXIMIZE PONDING EFFICIENCY.

(E) PAVED ROADWAY

MATCH (E) GRADE

20' R MIN.


50' MIN.

15' MIN.

TEMPORARY CULVERT AS NEEDED

**STABILIZED
CONSTRUCTION
ENTRANCE**

NTS

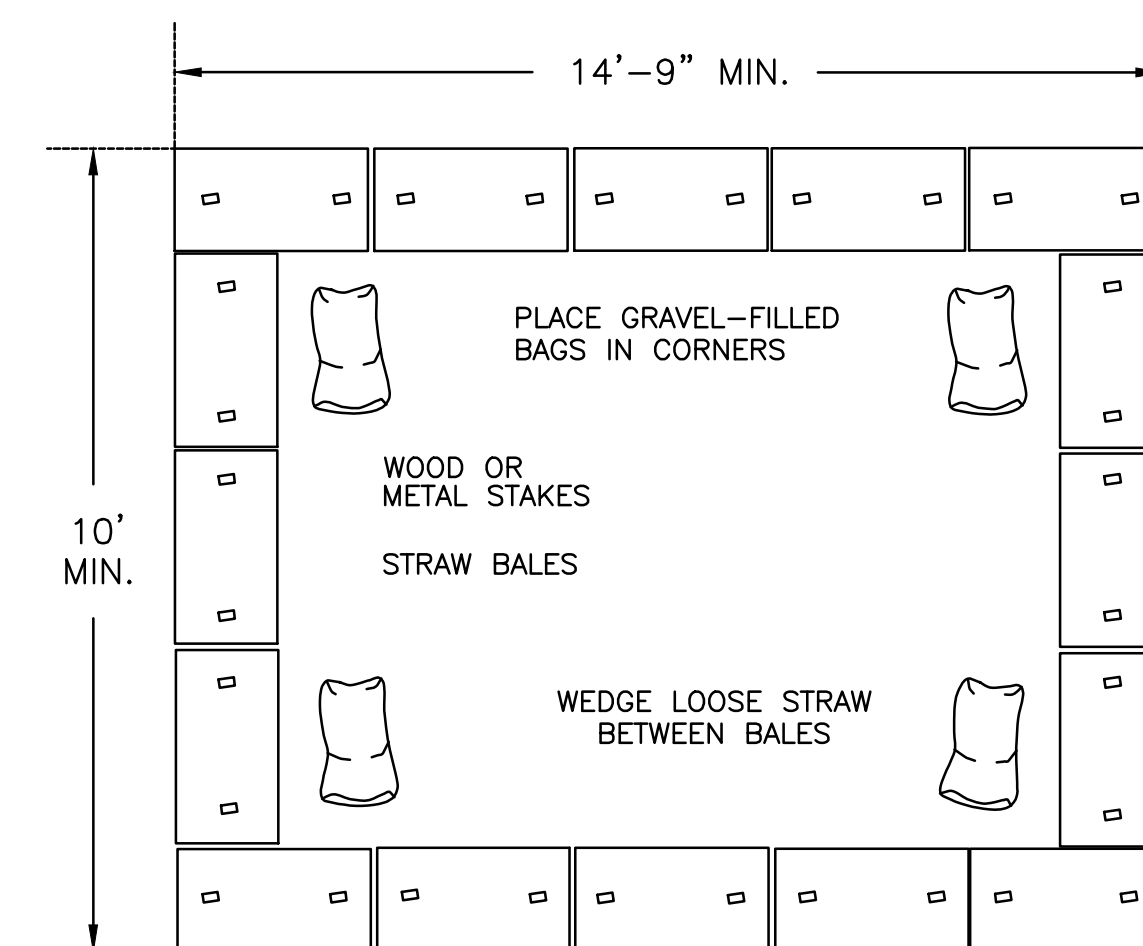

WOOD OR METAL STAKES
(2 PER BAIL)

PLASTIC LINER

STRAW BALES
(2 HIGH MAX)


STAPLES
(2 PER BAIL)

(E) GRADE

PLACE GRAVEL-FILLED
PAGS IN CORNERS

1' MIN.

NTS



PLAN BY:
TVCE
TRINITY VALLEY CONSULTING ENGINEERS
WILLOW CREEK, CA 95573
PO BOX 1567
67 WALNUT WAY
FAX (530) 629-3011
PHONE (530) 629-3000

PRELIMINARY

NO.	DATE:	REVISIONS

BRANNAN MOUNTAIN ROAD
WATER TANK
WILLOW CREEK COMMUNITY
SERVICES DISTRICT
135 WILLOW RD,
WILLOW CREEK, CA 95573

TANK PIPING
DETAILS

DESIGN BY: EK

DRAWN BY: SG


CHECKED BY: EK

DATE: 4/7/25

SCALE: NO SCALE

PROJECT NO: 209.19

D1.0



PLAN BY:
TVCE
TRINITY VALLEY CONSULTING ENGINEERS
WILLOW CREEK, CA 95573
PO BOX 1567
67 WALNUT WAY
FAX (530) 629-3011
PHONE (530) 629-3000

PRELIMINARY

NO.	DATE:	REVISIONS

BRANNAN MOUNTAIN ROAD
WATER TANK
WILLOW CREEK COMMUNITY
SERVICES DISTRICT
135 WILLOW RD,
WILLOW CREEK, CA 95573

TANK PIPING
DETAILS

DESIGN BY: EK

DRAWN BY: SG

CHECKED BY: EK


DATE: 4/7/25

SCALE: NO SCALE

PROJECT NO: 209.19

D2.0

C:\TYCE PROJECTS\BRANNAN MOUNTAIN WATER TANK\DWG\2.0 WATER DETAILS.DWG


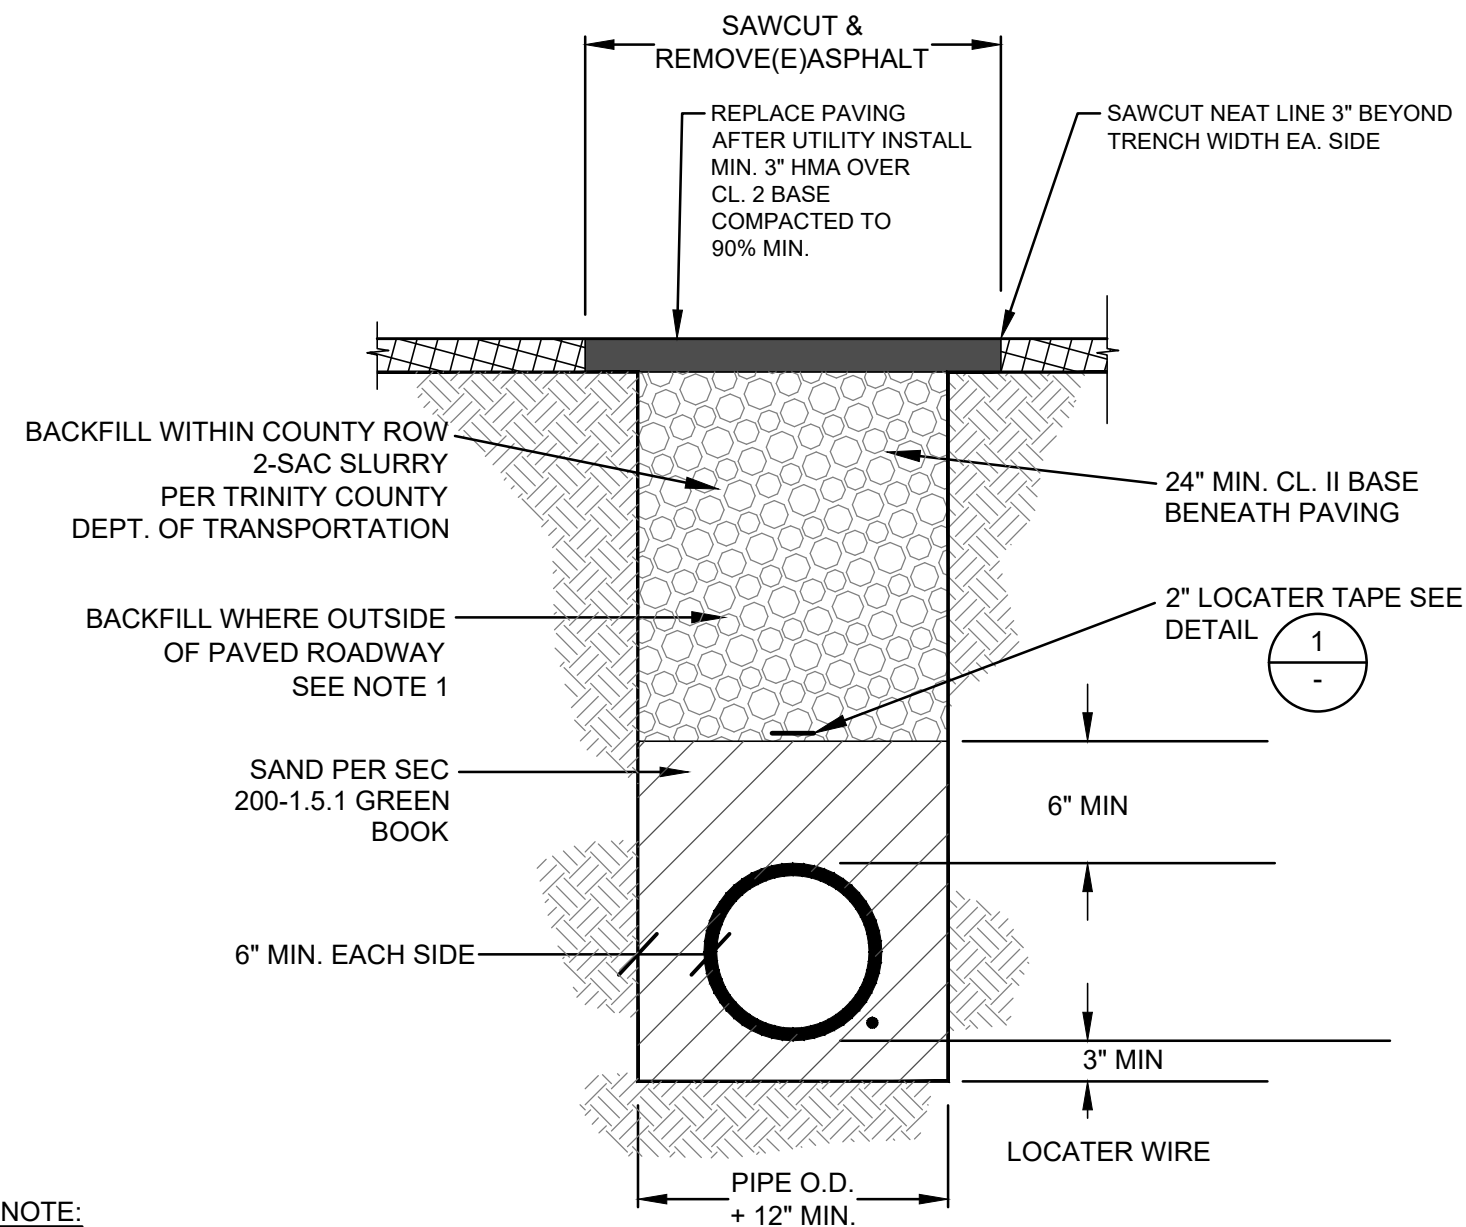


NOTE:


1. INTERMEDIATE BACKFILL SHALL BE ANY SUITABLE NATIVE OR IMPORTED GRANULAR MATERIAL. RELATIVE COMPACTION SHALL BE AT LEAST 90%

TYPICAL TRENCH DETAIL


NTS

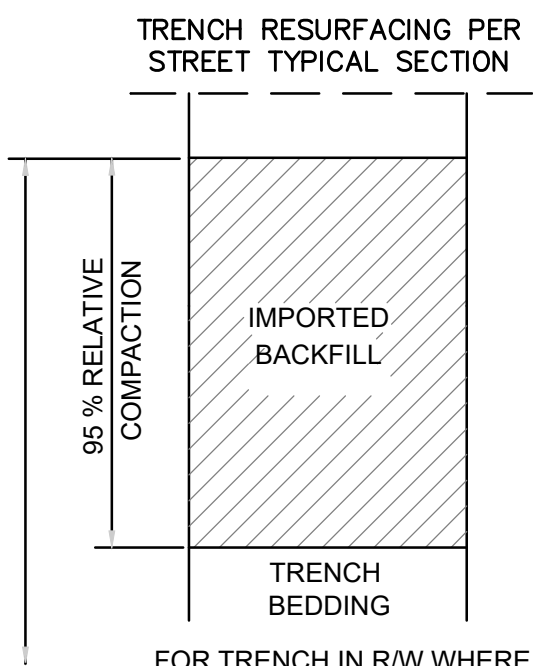


FOR TRENCH IN R/W WHERE NATIVE MATERIAL HAS A SAND EQUIVALENT OF LESS THAN 28

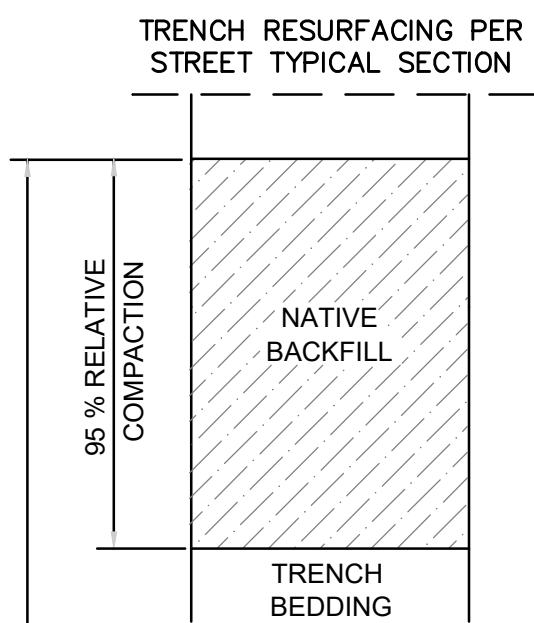

FOR TRENCH IN R/W WHERE NATIVE MATERIAL HAS A SAND EQUIVALENT OF MORE THAN 28

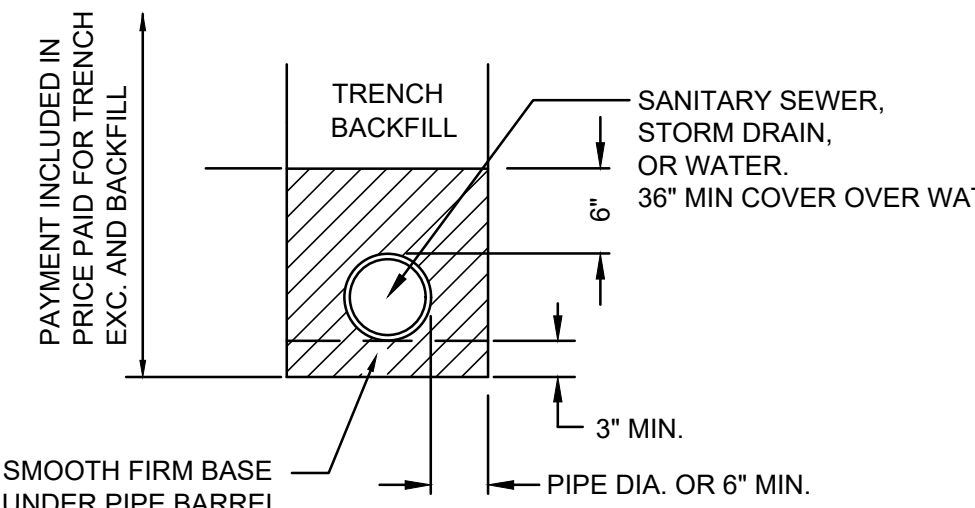

BEDDING

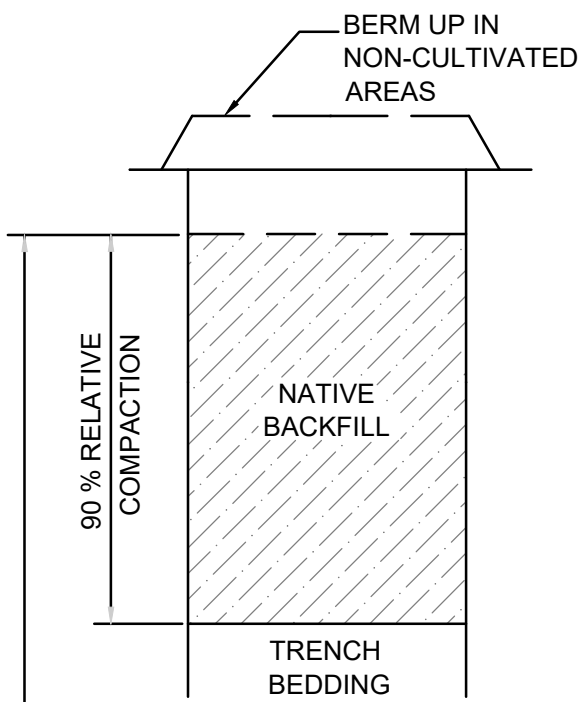

FOR TRENCH NOT IN ROADWAY

TRENCH BEDDING & BACKFILL NOTES:

1. BACKFILL BY HAND, COMPACT OR CONSOLIDATE TO PROVIDE SOLID BEDDING UNDER AND AROUND PIPE.
2. JETTING WILL NOT BE ALLOWED.
3. TRENCH BACKFILL WITHIN ROADWAY PER TRINITY COUNTY STDS. SEE TYPICAL TRENCH DETAIL 1 THIS SHEET.

TRENCH BEDDING & BACKFILL DETAIL

3

-

PLAN BY: **TVCE**
TRINITY VALLEY CONSULTING ENGINEERS
WILLOW CREEK, CA 95573
PO BOX 1567
67 WALNUT WAY
FAX (530) 629-3011
PHONE (530) 629-3000



PRELIMINARY

REVISIONS

BURNT RANCH ESTATES
DROUGHT RESILIENCE PROJECT
FOR BURNT RANCH ESTATES
MUTUAL WATER COMPANY
PO BOX 102
BURNT RANCH, CA 95527

WATER DETAILS

DESIGN BY: EK

DRAWN BY: SG

CHECKED BY: EK

DATE:


3/29/25

SCALE: NO SCALE


PROJECT NO:

D2.0

C:\TVC\PROJECTS\BRANNAN MOUNTAIN WATER TANK\WG04.0 FENCE DETAILS.DWG

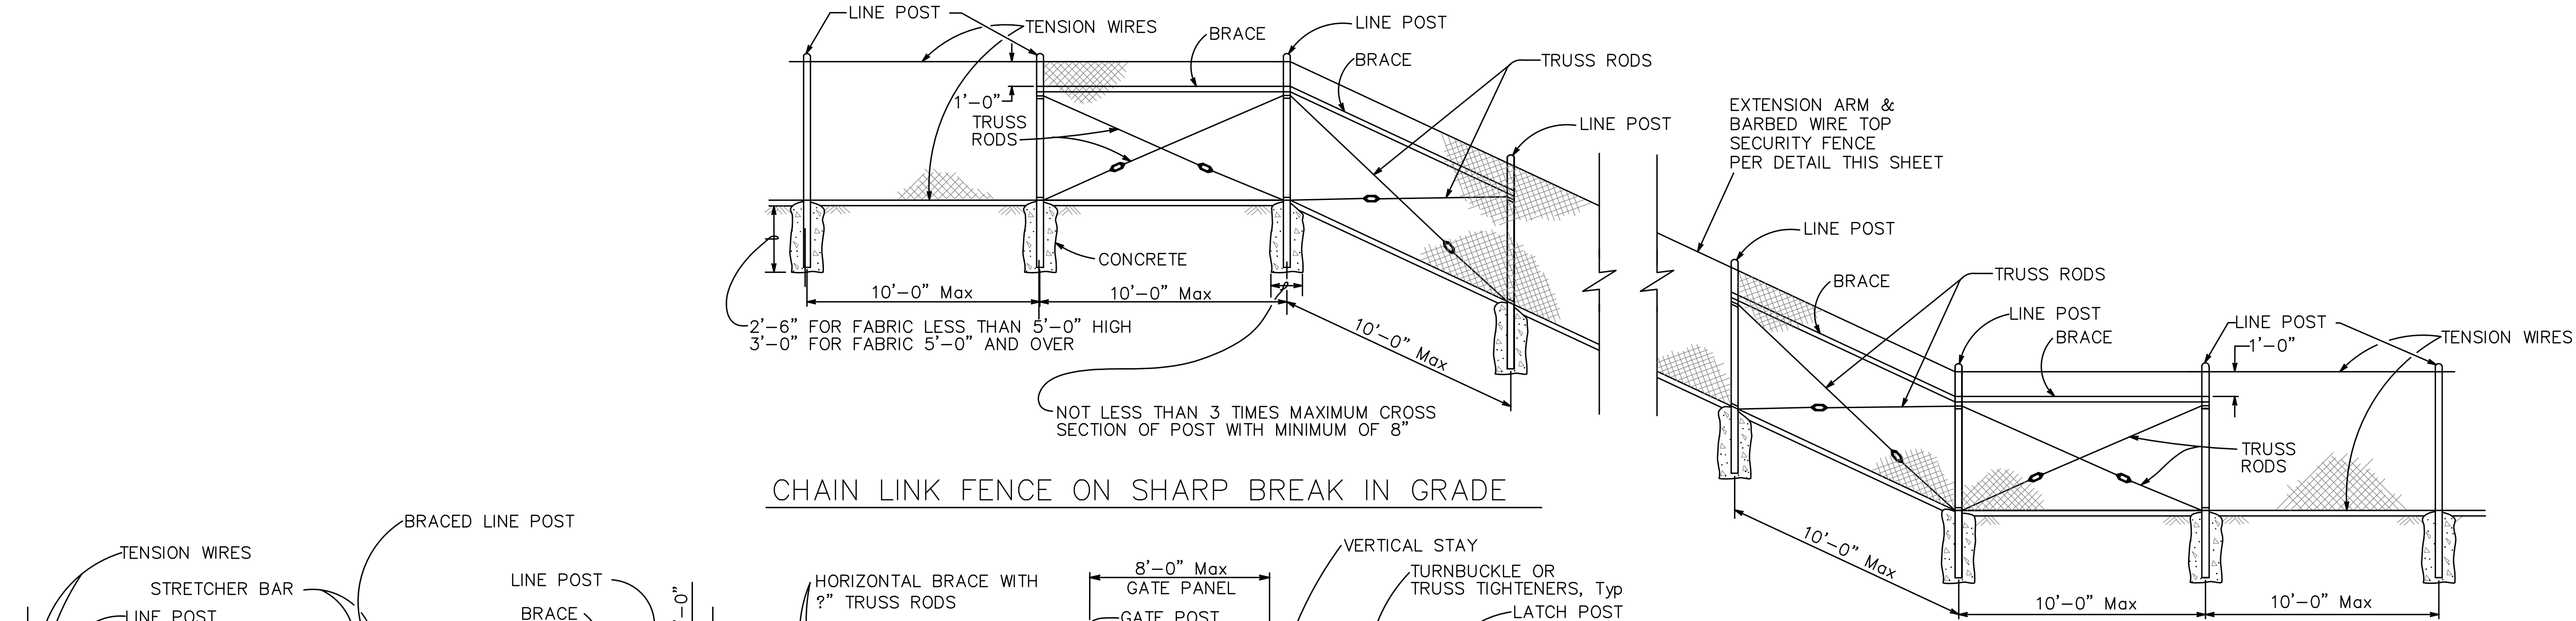

CHAIN LINK FENCE ON SHARP BREAK IN GRADE

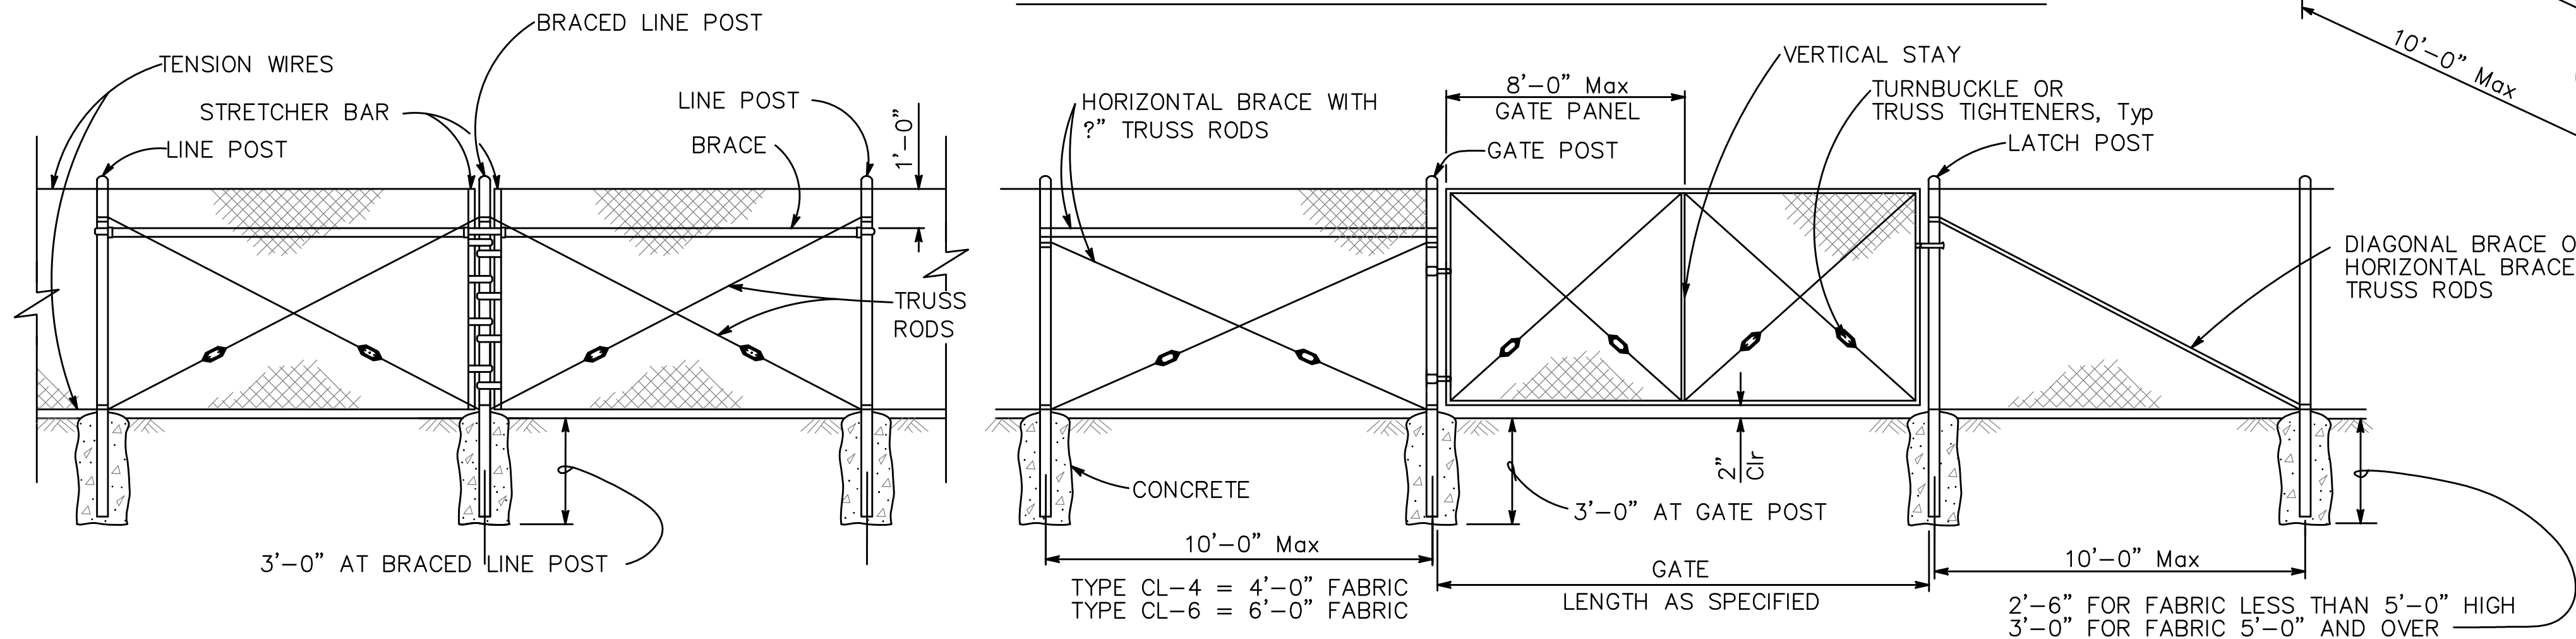


CHAIN LINK GATE INSTALLATION


NOTES:

- The below table shows examples of post and brace sections which may comply with the Specifications.
- Sections shown in the tables must also comply with the strength requirements and other provisions of the Specifications.
- Other sections which comply with the strength requirements and other provisions of the Specifications may be used on approval of the Engineer.
- Options exercised shall be uniform on any one project.
- Dimensions shown are nominal.
- Offset to be 2'-0" at monument locations, measured at right angles to R/W lines. Taper to achieve offset to be at least 20'-0" long.
- See Standard Plan A85B for Brace, Stretcher Bar, and Truss Tightener Details.

TYPICAL MEMBER DIMENSIONS (See Notes)							
FENCE HEIGHT	LINE POSTS		END, LATCH AND CORNER POSTS		BRACES		
	NPS (Std Wt)	ROLL FORMED	NPS (Std Wt)	ROLL FORMED	NPS (Std Wt)	ROLL FORMED	
6' AND LESS	1 1/2"	17/8"x15/8"	2"	2" x 1 3/4"	1 1/4"	1 5/8" x 1 1/4"	1 5/8" x 1 1/4"
OVER 6'	2"	2 1/4" x 1 3/4"	2 1/2"	2 1/2" x 2 1/2"	1 1/4"	1 5/8" x 1 1/4"	1 5/8" x 1 1/4"

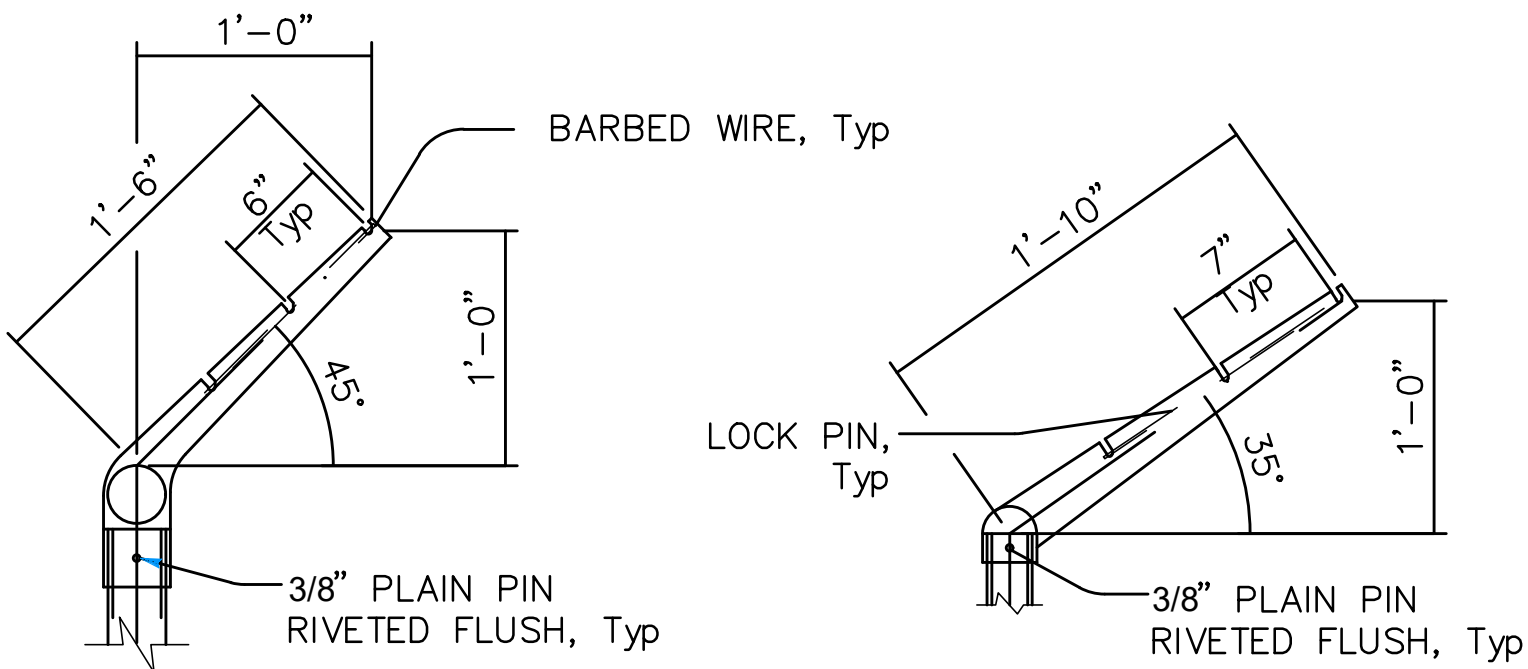

BARBED WIRE POST TOP

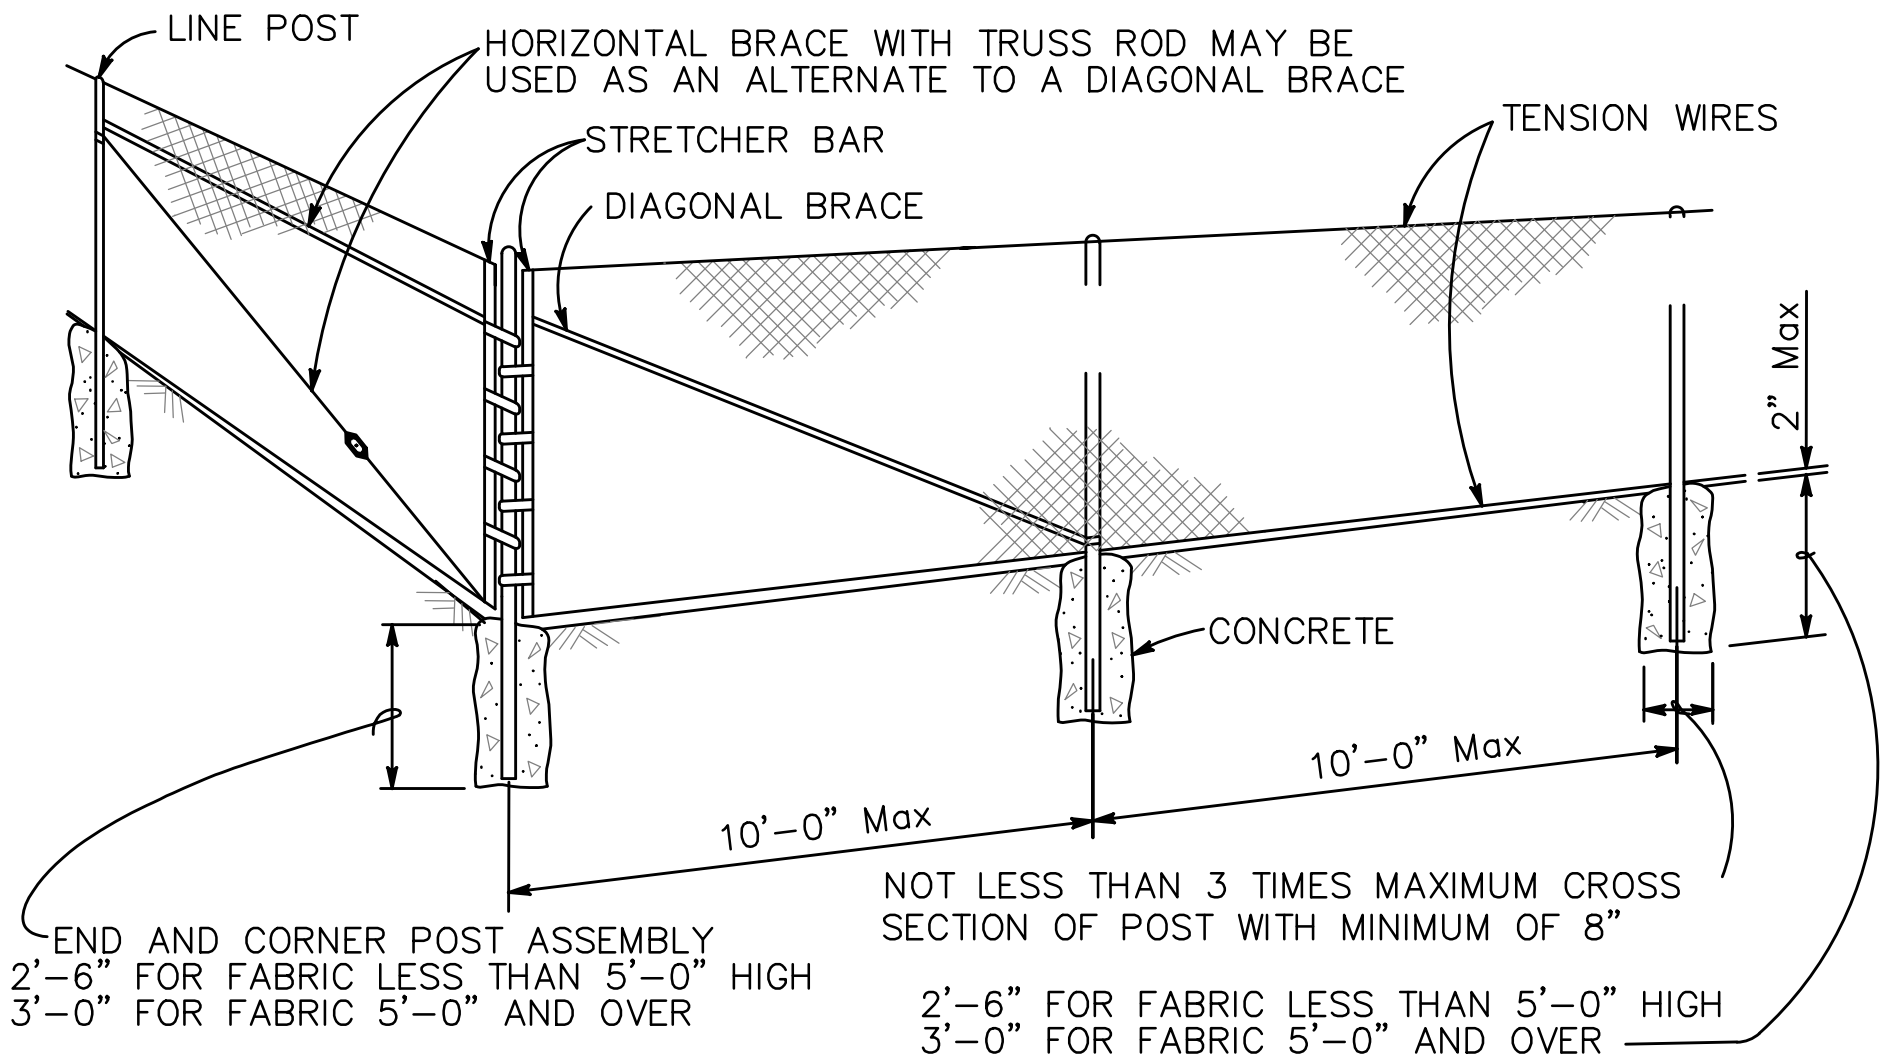

CORNER POST

GATE POST			
FENCE HEIGHT	GATE WIDTHS	NPS (Std Wt)	WEIGHT PER FOOT
6'-0" AND LESS	UP THRU 6'-0"	2 1/2"	5.79 LB
	OVER 6'-0" THRU 12'-0"	4"	10.79 LB
	OVER 12'-0" THRU 18'-0"	5"	14.62 LB
	OVER 18'-0" TO 24'-0" Max	6"	18.97 LB
OVER 6'-0"	UP THRU 6'-0"	3"	7.58 LB
	OVER 6'-0" THRU 12'-0"	5"	14.62 LB
	OVER 12'-0" THRU 18'-0"	6"	18.97 LB
	OVER 18'-0" TO 24'-0" Max	8"	28.55 LB

Above post dimensions and weights are minimums. Larger sizes may be used on approval of the Engineer.



PLAN BY:
TRINITY VALLEY CONSULTING ENGINEERS
WILLOW CREEK, CA 95573
PO BOX 1567
67 WALNUT WAY
FAX (530) 629-3011
PHONE (530) 629-3000

PRELIMINARY

REVISIONS

DATE:

NO.

BRANNAN MOUNTAIN ROAD
WATER TANK
WILLOW CREEK COMMUNITY
SERVICES DISTRICT
135 WILLOW RD,
WILLOW CREEK, CA 95573

FENCE DETAILS

DESIGN BY: EK

DRAWN BY: SG

CHECKED BY: EK

DATE:

4/7/25

SCALE: NO SCALE

PROJECT NO: 209.19

D4.0